

## SIPROTEC Compact 7SJ80 Multifunction Protection Relay



**Fig. 5/56**  
SIPROTEC Compact 7SJ80  
multifunction protection relay

### Description

The SIPROTEC Compact 7SJ80 relays can be used for line/feeder protection of high and medium-voltage networks with grounded, low-resistance grounded, isolated or a compensated neutral point. The relays have all the required functions to be applied as a backup relay to a transformer differential relay.

The 7SJ80 features “flexible protection functions”. 20 additional protection functions can be created by the user. For example, a rate of change of frequency function or a reverse power function can be created.

The relay provides circuit-breaker control, additional primary switching devices (grounding switches, transfer switches and isolating switches) can also be controlled from the relay. Automation or PLC logic functionality is also implemented in the relay. The integrated programmable logic (CFC) allows the user to add own functions, e.g. for the automation of switch-gear (including: interlocking, transfer and load shedding schemes). The user is also allowed to generate user-defined messages.

The communication module is independent from the protection. It can easily be exchanged or upgraded to future communication protocols.

### Highlights

Removable current and voltage terminals provide the ideal solution for fast and secure replacement of relays.

Binary input thresholds and current taps are software settings. There is thus no need to ever open the relay to adapt the hardware configuration to a specific application.

The relay provides 9 programmable function keys that can be used to replace push-buttons, select switches and control switches.

The battery for event and fault recording memory can be exchanged from the front of the relay.

The relay is available with IEC 61850 for incredible cost savings in applications (e.g. transfer schemes with synch-check, bus interlocking and load shedding schemes).

This compact relay provides protection, control, metering and PLC logic functionality. Secure and easy to use one page matrix IO programming is now a standard feature.

The housing creates a sealed dust proof environment for the relay internal electronics. Heat build up is dissipated through the surface area of the steel enclosure. No dusty or corrosive air can be circulated over the electronic components. The relay thus will maintain its tested insulation characteristic standards per IEC, IEEE, even if deployed in harsh environment.

### Function overview

#### Protection functions

- Time-overcurrent protection (50, 50N, 51, 51N)
- Directional time-overcurrent protection (67, 67N)
- Sensitive dir./non-dir. ground-fault detection (67Ns, 50Ns)
- Displacement voltage (59N/64)
- High-impedance restricted ground fault (87N)
- Inrush restraint
- Undercurrent monitoring (37)
- Overload protection (49)
- Under-/overvoltage protection (27/59)
- Under-/overfrequency protection (81O/U)
- Breaker failure protection (50BF)
- Phase unbalance or negative-sequence protection (46)
- Phase-sequence monitoring (47)
- Synch-check (25)
- Auto-reclosure (79)
- Fault locator (21FL)
- Lockout (86)

#### Control functions/programmable logic

- Commands for the ctrl. of CB, disconnect switches (isolators/isolating switches)
- Control through keyboard, binary inputs, DIGSI 4 or SCADA system
- User-defined PLC logic with CFC (e.g. interlocking)

#### Monitoring functions

- Operational measured values  $V, I, f$
- Energy metering values  $W_p, W_q$
- Circuit-breaker wear monitoring
- Minimum and maximum values
- Trip circuit supervision (74TC)
- Fuse failure monitor
- 8 oscillographic fault records

#### Communication interfaces

- System/service interface
  - IEC 61850
  - IEC 60870-5-103
  - PROFIBUS-DP
  - DNP 3.0
  - MODBUS RTU
- Ethernet interface for DIGSI 4
- USB front interface for DIGSI 4

#### Hardware

- 4 current transformers
- 0/3 voltage transformers
- 3/7 binary inputs (thresholds configurable using software)
- 5/8 binary outputs (2 changeover/Form C contacts)
- 1 live-status contact
- Pluggable current and voltage terminals

## Application

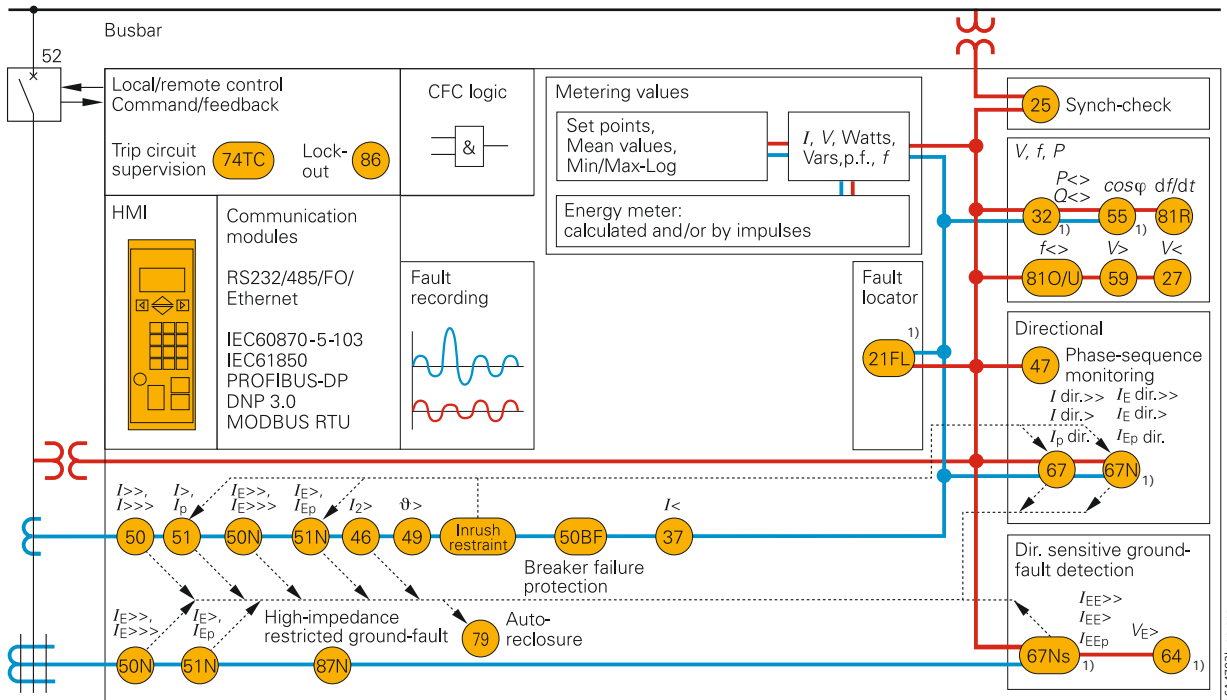


Fig. 5/57 Function diagram

The SIPROTEC Compact 7SJ80 unit is a numerical protection relay that can perform control and monitoring functions and therefore provide the user with a cost-effective platform for power system management, that ensures reliable supply of electrical power to the customers. The ergonomic design makes control easy from the relay front panel. A large, easy-to-read display was a key design factor.

## Control

The integrated control function permits control of disconnect devices, grounding switches or circuit-breakers through the integrated operator panel, binary inputs, DIGSI 4 or the control or SCADA/automation system (e.g. SICAM, SIMATIC or other vendors automation system). A full range of command processing functions is provided.

## Programmable logic

The integrated logic characteristics (CFC) allow the user to add own functions for automation of switchgear (e.g. interlocking) or switching sequence. The user can also generate user-defined messages. This functionality can form the base to create extremely flexible transfer schemes.

## Line protection

The 7SJ80 units can be used for line protection of high and medium-voltage networks with grounded, low-resistance grounded, isolated or a compensated neutral point.

## Transformer protection

The relay provides all the functions for backup protection for transformer differential protection. The inrush suppression effectively prevents unwanted trips that can be caused by inrush currents.

The high-impedance restricted ground-fault protection detects short-circuits and insulation faults on the transformer.

## Backup protection

The 7SJ80 can be used as a stand alone feeder protection relay or as a backup to other protection relays in more complex applications.

## Metering values

Extensive measured values (e.g.  $I$ ,  $V$ ), metered values (e.g.  $W_p$ ,  $W_q$ ) and limit values (e.g. for voltage, frequency) provide improved system management.

## Reporting

The storage of event logs, trip logs, fault records and statistics documents are stored in the relay to provide the user or operator all the key data required to operate modern substations.

## Switchgear cubicles for high/medium voltage

All units are designed specifically to meet the requirements of high/medium-voltage applications.

In general, no separate measuring instruments (e.g., for current, voltage, frequency, ...) or additional control components are necessary.

Typically the relay provides all required measurements, thus negating the use of additional metering devices like amp, volt or frequency meters. No additional control switches are required either. The relay provides 9 function keys that can be configured to replace pushbuttons and select switches.

1) Not available if function package 'Q' (synch-check, ANSI 25) is selected.

## Application

ANSI No.	IEC	Protection functions
50, 50N	$I>, I>>, I>>>, I_E>, I_E>>, I_E>>>$	Instantaneous and definite time-overcurrent protection (phase/neutral)
51, 51N	$I_p, I_{Ep}$	Inverse time-overcurrent protection (phase/neutral)
67, 67N <sup>1)</sup>	$I_{dir}>, I_{dir}>>, I_{p\ dir}$ $I_{Edir}>, I_{Edir}>>, I_{Ep\ dir}$	Directional time-overcurrent protection (definite/inverse, phase/neutral), Directional comparison protection
67Ns <sup>1)</sup> , 50Ns	$I_{EE}>, I_{EE}>>, I_{EEp}$	Directional/non-directional sensitive ground-fault detection
		Cold load pickup (dynamic setting change)
59N/64 <sup>1)</sup>	$V_E, V_0>$	Displacement voltage, zero-sequence voltage
87N		High-impedance restricted ground-fault protection
50BF		Breaker failure protection
79		Auto-reclosure
25		Synch-check
46	$I_2>$	Phase-balance current protection (negative-sequence protection)
47	$V_2>, \text{phase-sequence}$	Unbalance-voltage protection and/or phase-sequence monitoring
49	$\vartheta>$	Thermal overload protection
37	$I<$	Undercurrent monitoring
27, 59	$V<, V>$	Undervoltage/overvoltage protection
32 <sup>1)</sup>	$P<>, Q<>$	Forward-power, reverse-power protection
55 <sup>1)</sup>	$\cos \varphi$	Power factor
81O/U	$f>, f<$	Overfrequency/underfrequency protection
81R	$df/dt$	Rate-of-frequency-change protection
21FL <sup>1)</sup>		Fault locator

1) Not available if function package 'Q' (synch-check, ANSI 25) is selected.

Construction and hardware

Connection techniques and housing with many advantages

The relay housing is 1/6 of a 19" rack. The housing is thus identical in size to the 7SJ50 and 7SJ60 relays that makes replacement very easy. The height is 244 mm (9.61").

Pluggable current and voltage terminals allow for pre-wiring and simplify the exchange of devices. CT shorting is done in the removable current terminal block. It is thus not possible to open-circuit a secondary current transformer.

All binary inputs are independent and the pick-up thresholds are settable using software settings (3 stages). The relay current transformer taps (1 A/5 A) are new software settings. Up to 9 function keys can be programmed for predefined menu entries, switching sequences, etc. The assigned function of the function keys can be shown in the display of the relay.

If a conventional (inductive) set of primary voltage transformers is not available in the feeder, the phase-to-ground voltages can be measured directly through a set of capacitor cones in the medium-voltage switchgear. In this case, the functions directional over-current protection (ANSI 67/67N), voltage protection (ANSI 27/59) and frequency protection (ANSI 81O/U) are available.

Protection functions

Time-overcurrent protection (ANSI 50, 50N, 51, 51N)

This function is based on the phase-selective measurement of the three phase currents and the ground current (four transformers). Three definite-time over-current protection elements (DMT) are available both for the phase and the ground elements. The current threshold and the delay time can be set in a wide range. Inverse-time overcurrent protection characteristics (IDMTL) can also be selected and activated.

Reset characteristics

Time coordination with electromechanical relays are made easy with the inclusion of the reset characteristics according to ANSI C37.112 and IEC 60255-3 /BS 142 standards. When using the reset characteristic (disk emulation), the reset process is initiated after the fault current has disappeared. This reset process corresponds to

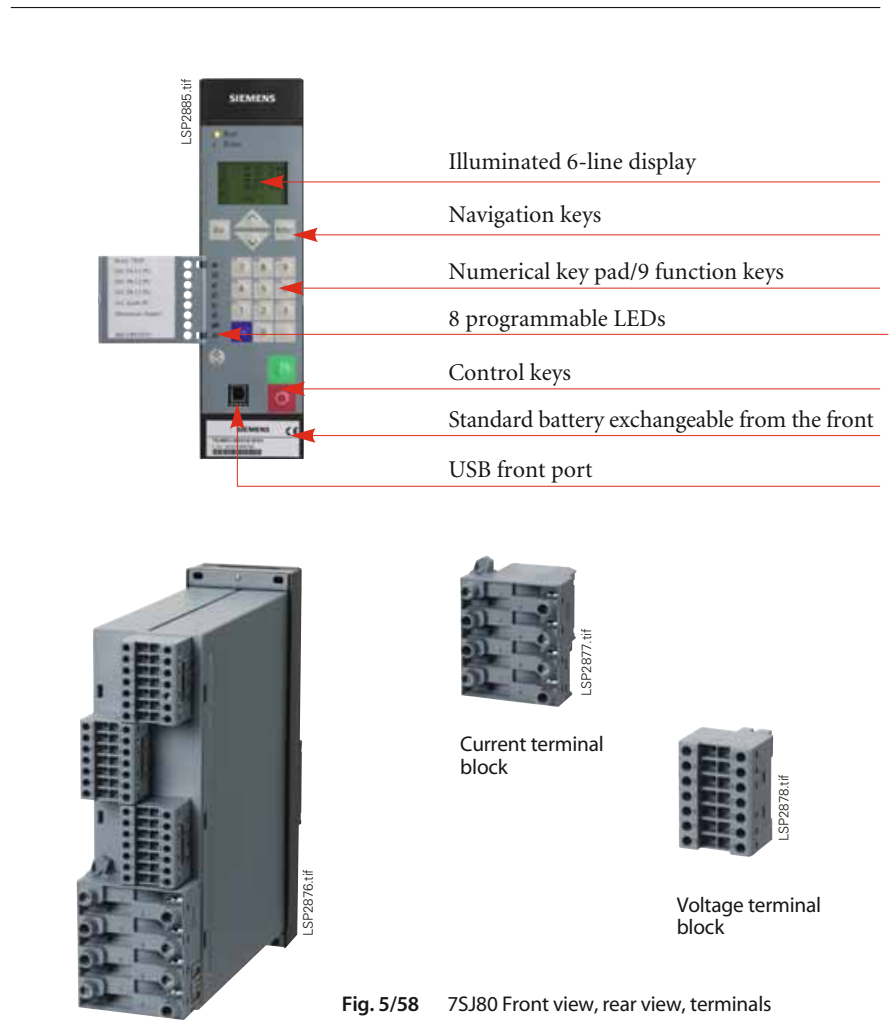


Fig. 5/58 7SJ80 Front view, rear view, terminals

Available inverse-time characteristics

Characteristics acc. to	ANSI/IEEE	IEC 60255-3
Inverse	•	•
Short inverse	•	
Long inverse	•	•
Moderately inverse	•	
Very inverse	•	•
Extremely inverse	•	•

the reverse movement of the Ferraris disk of an electromechanical relay (disk emulation).

Inrush restraint

The relay features second harmonic restraint. If second harmonic content is detected during the energization of a transformer, the pickup of non-directional and directional elements are blocked.

Cold load pickup/dynamic setting change

The pickup thresholds and the trip times of the directional and non-directional time-overcurrent protection functions can be changed via binary inputs or by settable time control.

### Protection functions

#### Directional time-overcurrent protection (ANSI 67, 67N)

Directional phase and ground protection are separate functions. They operate in parallel to the non-directional overcurrent elements. Their pickup values and delay times can be set separately. Definite-time and inverse-time characteristics are offered. The tripping characteristic can be rotated by  $\pm 180$  degrees.

By making use of the voltage memory, the directionality can be determined reliably even for close-in (local) faults. If the primary switching device closes onto a fault and the voltage is too low to determine direction, the direction is determined using voltage from the memorized voltage. If no voltages are stored in the memory, tripping will be according to the set characteristic.

For ground protection, users can choose whether the direction is to be calculated using the zero-sequence or negative-sequence system quantities (selectable). If the zero-sequence voltage tends to be very low due to the zero-sequence impedance it will be better to use the negative-sequence quantities.


#### Directional comparison protection (cross-coupling)

It is used for selective instantaneous tripping of sections fed from two sources, i.e. without the disadvantage of time delays of the set characteristic. The directional comparison protection is suitable if the distances between the protection zones are not significant and pilot wires are available for signal transmission. In addition to the directional comparison protection, the directional coordinated time-overcurrent protection is used for complete selective backup protection.


#### (Sensitive) directional ground-fault detection (ANSI 59N/64, 67Ns, 67N)

For isolated-neutral and compensated networks, the direction of power flow in the zero sequence is calculated from the zero-sequence current  $I_0$  and zero-sequence voltage  $V_0$ .

For networks with an isolated neutral, the reactive current component is evaluated; for compensated networks, the active current component or residual resistive current is evaluated. For special network conditions, e.g. high-resistance grounded networks with ohmic-capacitive

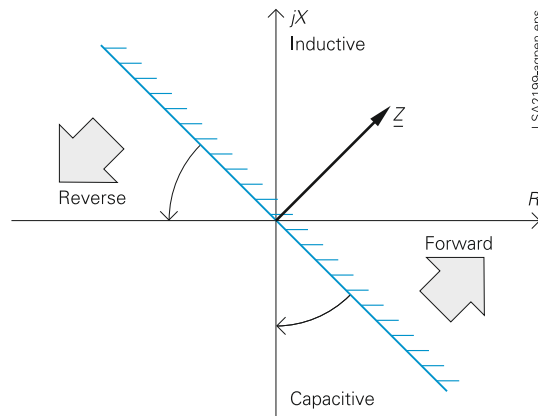

**Fig. 5/59**  
Directional characteristic of the directional time-overcurrent protection

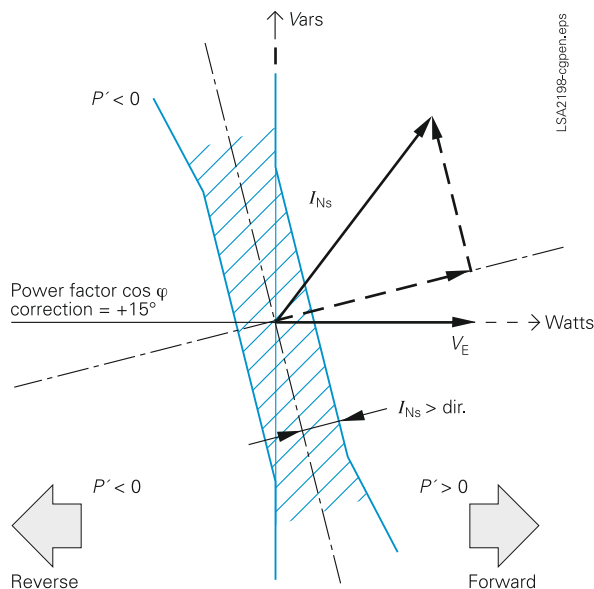

**Fig. 5/60**  
Directional determination using cosine measurements for compensated networks

ground-fault current or low-resistance grounded networks with ohmic-inductive current, the tripping characteristics can be rotated approximately  $\pm 45$  degrees.

Two modes of ground-fault direction detection can be implemented: tripping or "signalling only mode".

It has the following functions:

- TRIP via the displacement voltage  $V_E$ .
- Two instantaneous elements or one instantaneous plus one user-defined characteristic.
- Each element can be set to forward, reverse or non-directional.
- The function can also be operated in the insensitive mode as an additional short-circuit protection.

#### (Sensitive) ground-fault detection (ANSI 50Ns, 51Ns / 50N, 51N)

For high-resistance grounded networks, a sensitive input transformer is connected to a phase-balance neutral current transformer (also called core-balance CT).

The function can also be operated in the normal mode as an additional short-circuit protection for neutral or residual ground protection.

## Protection functions

Phase-balance current protection (ANSI 46)  
(Negative-sequence protection)

By measuring current on the high side of the transformer, the two-element phase-balance current/negative-sequence protection detects high-resistance phase-to-phase faults and phase-to-ground faults on the low side of a transformer (e.g. Dy 5 or Delta/Star 150 deg.). This function provides backup protection for high-resistance faults through the transformer.

## Breaker failure protection (ANSI 50BF)

If a faulted portion of the electrical circuit is not disconnected when a trip command is issued to a circuit-breaker, another trip command can be initiated using the breaker failure protection which trips the circuit-breaker of an upstream feeder. Breaker failure is detected if, after a trip command is issued and the current keeps on flowing into the faulted circuit. It is also possible to make use of the circuit-breaker position contacts (52a or 52b) for indication as opposed to the current flowing through the circuit-breaker.

## High-impedance restricted ground-fault protection (ANSI 87N)

The high-impedance measurement principle is a simple and sensitive method to detect ground faults, especially on transformers. It can also be used on motors, generators and reactors when they are operated on a grounded network.

When applying the high-impedance measurement principle, all current transformers in the protected area are connected in parallel and operated through one common resistor of relatively high  $R$ . The voltage is measured across this resistor (see Fig. 5/61). The voltage is measured by detecting the current through the (external) resistor  $R$  at the sensitive current measurement input  $I_{EE}$ . The varistor  $V$  serves to limit the voltage in the event of an internal fault. It limits the high instantaneous voltage spikes that can occur at current transformer saturation. At the same time, this results to smooth the voltage without any noteworthy reduction of the average value. If no faults have occurred and in the event of external or through faults, the system is at equilibrium, and the voltage through the resistor is approximately zero. In the event of internal faults, an imbalance occurs which leads to a voltage and a current flowing through the resistor  $R$ .

The same type of current transformers must be used and must at least offer a separate core for the high-impedance restricted ground-fault protection. They must have the same transformation ratio and approximately an identical knee-point voltage. They should also have only minimal measuring errors.

## Auto-reclosure (ANSI 79)

Multiple re-close cycles can be set by the user and lockout will occur if a fault is present after the last re-close cycle. The following functions are available:

- 3-pole ARC for all types of faults
- Separate settings for phase and ground faults
- Multiple ARC, one rapid auto-reclosure (RAR) and up to nine delayed auto-reclosures (DAR)
- Initiation of the ARC is dependant on the trip command selected (e.g. 46, 50, 51, 67)
- The ARC function can be blocked by activating a binary input
- The ARC can be initiated from external or by the PLC logic (CFC)
- The directional and non-directional elements can either be blocked or operated non-delayed depending on the auto-reclosure cycle
- If the ARC is not ready it is possible to perform a dynamic setting change of the directional and non-directional overcurrent elements

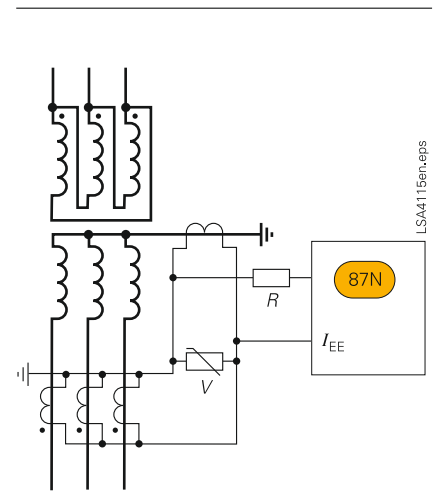


Fig. 5/61 High-impedance restricted ground-fault protection

## Protection functions

### Flexible protection functions

The 7SJ80 enables the user to easily add up to 20 additional protective functions. Parameter definitions are used to link standard protection logic with any chosen characteristic quantity (measured or calculated quantity) (Fig. 5/62). The standard logic consists of the usual protection elements such as the pickup set point, the set delay time, the TRIP command, a block function, etc. The mode of operation for current, voltage, power and power factor quantities can be three-phase or single-phase. Almost all quantities can be operated with ascending or descending pickup stages (e.g. under and over voltage). All stages operate with protection priority.

Protection functions/stages available are based on the available measured analog quantities:

Function	ANSI No.
$I>, I_E>$	50, 50N
$V<, V>, V_E>$	27, 59, 64
$3I_0>, I_1>, I_2>, I_2/I_1$	50N, 46
$3V_0>, V_1><, V_2><$	59N, 47
$P><, Q><$	32
$\cos \varphi$ (p.f.)><	55
$f><$	81O, 81U
$df/dt><$	81R

For example, the following can be implemented:

- Reverse power protection (ANSI 32R)
- Rate-of-frequency-change protection (ANSI 81R)

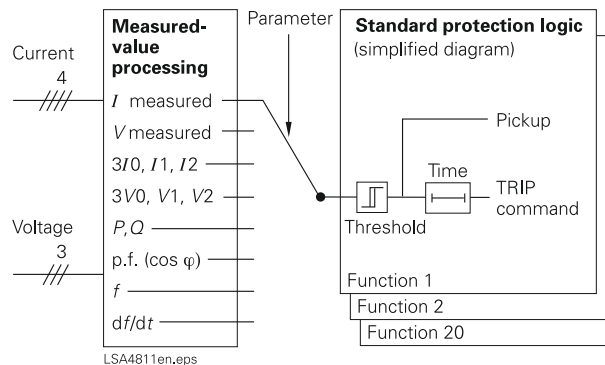


Fig. 5/62 Flexible protection functions

### Synch-check (ANSI 25)

When closing a circuit-breaker, the units can check whether two separate networks are synchronized. Voltage-, frequency- and phase-angle-differences are checked to determine whether synchronous conditions exist.

### Trip circuit supervision (ANSI 74TC)

One or two binary inputs can be used for monitoring the circuit-breaker trip coil including its incoming cables. An alarm signal is generated whenever the circuit is interrupted. The circuit breaker trip coil is monitored in the open and closed position. Interlocking features can be implemented to ensure that the beaker can only be closed if the trip coil is functional.

### Lockout (ANSI 86)

All binary output statuses can be memorized. The LED reset key is used to reset the lockout state. The lockout state is also stored in the event of supply voltage failure. Reclosure can only occur after the lockout state is reset.

### Thermal overload protection (ANSI 49)

To protect cables and transformers, an overload protection function with an integrated warning/alarm element for temperature and current can be used. The temperature is calculated using a thermal homogeneous body model (per IEC 60255-8), it considers the energy entering the equipment and the energy losses. The calculated temperature is constantly adjusted according to the calculated losses. The function considers loading history and fluctuations in load.

### Settable dropout delay times

If the relays are used in conjunction with electromechanical relays, in networks with intermittent faults, the long dropout times of the electromechanical relay (several hundred milliseconds) can lead to problems in terms of time coordination/grading. Proper time coordination/grading is only possible if the dropout or reset time is approximately the same. This is why the parameter for dropout or reset times can be defined for certain functions such as time-overcurrent protection, ground short-circuit and phase-balance current protection.

### Undercurrent monitoring (ANSI 37)

A sudden drop in current, which can occur due to a reduced load, is detected with this function. This may be due to shaft that breaks, no-load operation of pumps or fan failure.

## Protection functions

### ■ Voltage protection

#### Overvoltage protection (ANSI 59)

The two-element overvoltage protection detects unwanted network and machine overvoltage conditions. The function can operate either with phase-to-phase, phase-to-ground, positive phase-sequence or negative phase-sequence voltage. Three-phase and single-phase connections are possible.

#### Undervoltage protection (ANSI 27)

The two-element undervoltage protection provides protection against dangerous voltage drops (especially for electric machines). Applications include the isolation of generators or motors from the network to avoid undesired operating conditions and a possible loss of stability. Proper operating conditions of electrical machines are best evaluated with the positive-sequence quantities. The protection function is active over a wide frequency range (45 to 55, 55 to 65 Hz). Even when falling below this frequency range the function continues to work, however, with decrease accuracy.

The function can operate either with phase-to-phase, phase-to-ground or positive phase-sequence voltage, and can be monitored with a current criterion. Three-phase and single-phase connections are possible.

#### Frequency protection (ANSI 81O/U)

Frequency protection can be used for overfrequency and underfrequency protection. Electric machines and parts of the system are protected from unwanted frequency deviations. Unwanted frequency changes in the network can be detected and the load can be removed at a specified frequency setting.

Frequency protection can be used over a wide frequency range (40 to 60 (for 50 Hz), 50 to 70 (for 60 Hz)). There are four elements (individually set as overfrequency, underfrequency or OFF) and each element can be delayed separately. Blocking of the frequency protection can be performed by activating a binary input or by using an undervoltage element.

#### Fault locator (ANSI 21FL)

The integrated fault locator calculates the fault impedance and the distance to fault. The results are displayed in  $\Omega$ , kilometers (miles) and in percent of the line length.

#### Customized functions (ANSI 51V, etc.)

Additional functions, which are not time critical, can be implemented using the CFC measured values. Typical functions include reverse power, voltage controlled overcurrent, phase angle detection, and zero-sequence voltage detection.

## Control and automatic functions

### Control

In addition to the protection functions, the SIPROTEC 4 and SIPROTEC Compact units also support all control and monitoring functions that are required for operating medium-voltage or high-voltage substations.

The main application is reliable control of switching and other processes.

The status of primary equipment or auxiliary devices can be obtained from auxiliary contacts and communicated to the 7SJ80 via binary inputs. Therefore it is possible to detect and indicate both the OPEN and CLOSED position or a fault or intermediate circuit-breaker or auxiliary contact position.

The switchgear or circuit-breaker can be controlled via:

- integrated operator panel
- binary inputs
- substation control and protection system
- DIGSI 4

#### Automation / user-defined logic

With integrated logic, the user can create, through a graphic interface (CFC), specific functions for the automation of switchgear or a substation. Functions are activated using function keys, a binary input or through the communication interface.

#### Switching authority

Switching authority is determined by set parameters or through communications to the relay. If a source is set to "LOCAL", only local switching operations are possible. The following sequence for switching authority is available: "LOCAL"; DIGSI PC program, "REMOTE".

There is thus no need to have a separate Local/Remote switch wired to the breaker coils and relay. The local/remote selection can be done using a function key on the front of the relay.

#### Command processing

This relay is designed to be easily integrated into a SCADA or control system. Security features are standard and all the functionality of command processing is offered. This includes the processing of single and double commands with or without feedback, sophisticated monitoring of the control hardware and software, checking of the external process, control actions using functions such as runtime monitoring and automatic command termination after output. Here are some typical applications:

- Single and double commands using 1, 1 plus 1 common or 2 trip contacts
- User-definable bay interlocks
- Operating sequences combining several switching operations such as control of circuit-breakers, disconnectors and grounding switches
- Triggering of switching operations, indications or alarm by combination with existing information

#### Assignment of feedback to command

The positions of the circuit-breaker or switching devices and transformer taps are acquired through feedback. These indication inputs are logically assigned to the corresponding command outputs. The unit can therefore distinguish whether the indication change is a result of switching operation or whether it is an undesired spontaneous change of state.



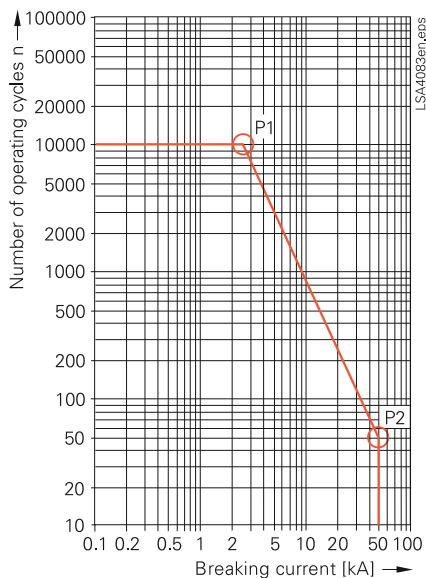


Fig. 5/63 CB switching cycle diagram

#### Chatter disable

The chatter disable feature evaluates whether, in a set period of time, the number of status changes of indication input exceeds a specified number. If exceeded, the indication input is blocked for a certain period, so that the event list will not record excessive operations.

#### Indication filtering and delay

Binary indications can be filtered or delayed.

Filtering serves to suppress brief changes in potential at the indication input. The indication is passed on only if the indication voltage is still present after a set period of time. In the event of an indication delay, there is a delay for a preset time. The information is passed on only if the indication voltage is still present after this time.

#### Indication derivation

User-definable indications can be derived from individual or a group of indications. These grouped indications are of great value to the user that need to minimize the number of indications sent to the system or SCADA interface.

### Further functions

#### Measured values

The r.m.s. values are calculated from the acquired current and voltage along with the power factor, frequency, active and reactive power. The following functions are available for measured value processing:

- Currents  $I_{L1}, I_{L2}, I_{L3}, I_E, I_{EE}$  (67Ns)
- Voltages  $V_{L1}, V_{L2}, V_{L3}, V_{L1L2}, V_{L2L3}, V_{L3L1}$
- Symmetrical components  $I_1, I_2, 3I_0; V_1, V_2, V_0$
- Power Watts, Vars, VA/P, Q, S (P, Q: total and phase selective)
- Power factor ( $\cos \varphi$ ), (total and phase selective)
- Frequency
- Energy  $\pm$  kWh,  $\pm$  kVarh, forward and reverse power flow
- Mean as well as minimum and maximum current and voltage values
- Operating hours counter
- Mean operating temperature of the overload function
- Limit value monitoring  
Limit values can be monitored using programmable logic in the CFC. Commands can be derived from this limit value indication.
- Zero suppression  
In a certain range of very low measured values, the value is set to zero to suppress interference.

#### Metered values

For internal metering, the unit can calculate an energy metered value from the measured current and voltage values. If an external meter with a metering pulse output is available, the 7SJ80 can obtain and process metering pulses through an indication input.

The metered values can be displayed and passed on to a control center as an accumulated value with reset. A distinction is made between forward, reverse, active and reactive energy.

#### Circuit-breaker wear monitoring

Methods for determining circuit-breaker contact wear or the remaining service life of a circuit-breaker (CB) allow CB maintenance intervals to be aligned to their actual degree of wear. The benefit lies in reduced maintenance costs.

There is no exact mathematical method to calculate the wear or the remaining service life of a circuit-breaker that takes arc-chamber's physical conditions into account when the CB opens. This is why various methods of determining CB wear have evolved which reflect the different operator philosophies. To do justice to these, the relay offers several methods:

- $\Sigma I$
- $\Sigma I^x$ , with  $x = 1 \dots 3$
- $\Sigma i^2 t$

The devices also offer a new method for determining the remaining service life:

- Two-point method

The CB manufacturers double-logarithmic switching cycle diagram (see Fig. 5/63) and the breaking current at the time of contact opening serve as the basis for this method. After CB opening, the two-point method calculates the remaining number of possible switching cycles. Two points P1 and P2 only have to be set on the device. These are specified in the CB's technical data.

All of these methods are phase-selective and a limit value can be set in order to obtain an alarm if the actual value falls below or exceeds the limit value during determination of the remaining service life.

#### Commissioning

Commissioning could not be easier and is supported by DIGSI 4. The status of the binary inputs can be read individually and the state of the binary outputs can be set individually. The operation of switching elements (circuit-breakers, disconnect devices) can be checked using the switching functions of the relay. The analog measured values are represented as wide-ranging operational measured values. To prevent transmission of information to the control center during maintenance, the communications can be disabled to prevent unnecessary data from being transmitted. During commissioning, all indications with test tag for test purposes can be connected to a control and protection system.

#### Test operation

During commissioning, all indications can be passed to a control system for test purposes.

## Communication

The relay offers flexibility with reference to its communication to substation automation systems and industrial SCADA or DCS systems. The communication module firmware can be changed to communicate using another protocol or the modules can be changed completely for a different connection or protocol. It will thus be possible to move to future communication protocols like popular Ethernet-based protocols with ease.

### USB interface

There is an USB interface on the front of the relay. All the relay functions can be set using a PC and DIGSI 4 protection operation program. Commissioning tools and fault analysis are built into the DIGSI program and are used through this interface.

### Interfaces

A number of communication modules suitable for various applications can be fitted at the bottom of the housing. The modules can be easily replaced by the user. The interface modules support the following applications:

- **System/service interface**  
Communication with a central control system takes place through this interface. Radial or ring type station bus topologies can be configured depending on the chosen interface. Furthermore, the units can exchange data through this interface via Ethernet and the IEC 61850 protocol and can also be accessed using DIGSI.
- **Ethernet interface**  
The Ethernet interface was implemented for access to a number of protection units using DIGSI.

### System interface protocols (retrofittable)

#### IEC 61850 protocol

Since 2004, the Ethernet-based IEC 61850 protocol is a global standard for protection and control systems used by power utilities. Siemens was the first manufacturer to implement this standard. This protocol makes peer-to-peer communication possible. It is thus possible to set up masterless systems to perform interlocking or transfer schemes. Configuration is done using DIGSI.

#### IEC 60870-5-103 protocol

The IEC 60870-5-103 protocol is an international standard for the transmission of protective data and fault recordings. All messages from the unit and also control commands can be transferred by means of published, Siemens-specific extensions to the protocol. As a further option a redundant IEC 60870-5-103 module is available as well. With the redundant module it will be possible to read and change single parameters.

#### PROFIBUS-DP protocol

PROFIBUS-DP is a widespread protocol in industrial automation. Through PROFIBUS-DP, SIPROTEC units make their information available to a SIMATIC controller or receive commands from a central SIMATIC controller or PLC. Measured values can also be transferred to a PLC master.

#### MODBUS RTU protocol

This simple, serial protocol is mainly used in industry and by power utilities, and is supported by a number of relay manufacturers. SIPROTEC units function as MODBUS slaves, making their information available to a master or receiving information from it. A time-stamped event list is available.

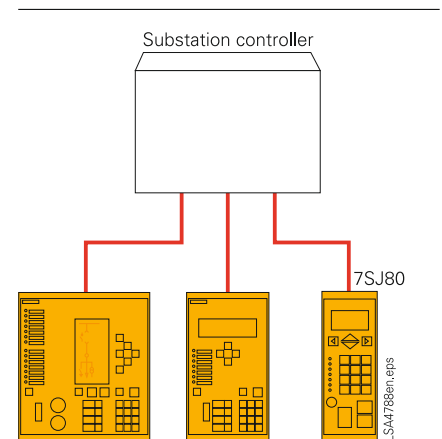


Fig. 5/64  
IEC 60870-5-103: Radial fiber-optic connection

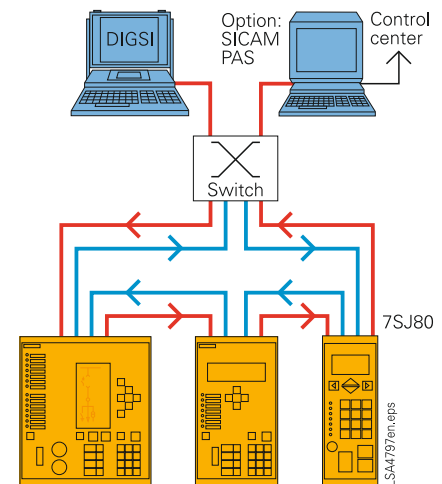


Fig. 5/65  
Bus structure for station bus with Ethernet and IEC 61850, fiber-optic ring

## Communication

### DNP 3.0 protocol


Power utilities use the serial DNP 3.0 (Distributed Network Protocol) for the station and network control levels. SIPROTEC units function as DNP slaves, supplying their information to a master system or receiving information from it.

### System solutions for protection and station control

Units featuring IEC 60870-5-103 interfaces can be connected to SICAM in parallel via the RS485 bus or radially by fiber-optic link. Through this interface, the system is open for the connection to other manufacturers systems (see Fig. 5/64).

Because of the standardized interfaces, SIPROTEC units can also be integrated into systems of other manufacturers or in SIMATIC. Electrical RS485 or optical interfaces are available. The best physical data transfer medium can be chosen thanks to opto-electrical converters. Thus, the RS485 bus allows low-cost wiring in the cubicles and an interference-free optical connection to the master can be established.

For IEC 61850, an interoperable system solution is offered with SICAM. Through the 100 Mbits/s Ethernet bus, the units are linked with SICAM electrically or optically to the station PC. The interface is standardized, thus also enabling direct connection to relays of other manufacturers and into the Ethernet bus. With IEC 61850, however, the relays can also be used in other manufacturers' systems (see Fig. 5/65).

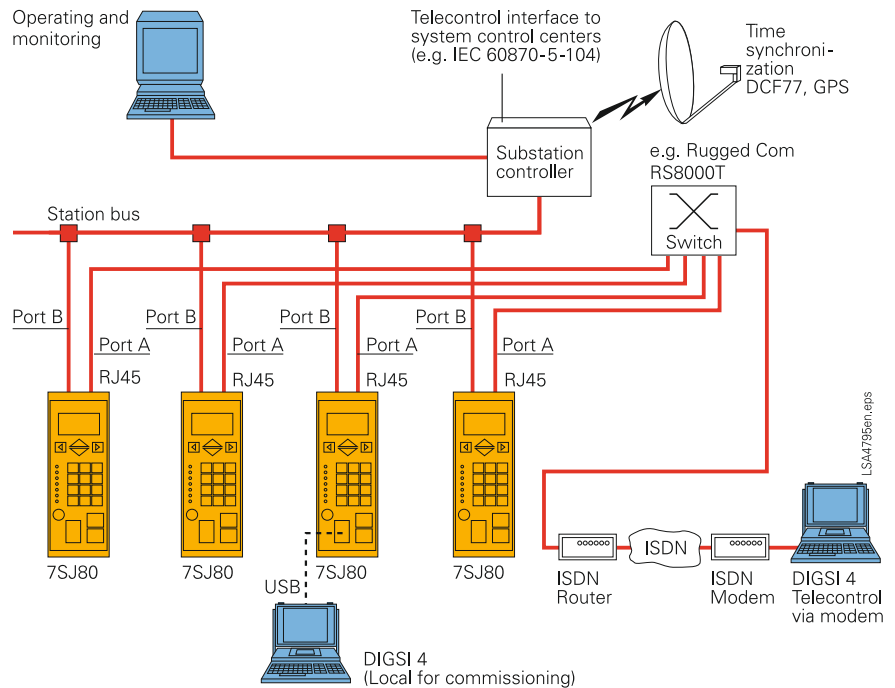

**Fig. 5/66**  
System solution/communication




**Fig. 5/67**  
Optical Ethernet communication module  
for IEC 61850 with integrated Ethernet-switch

Typical connections


■ Connection of current and voltage transformers

Standard connection


For grounded networks, the ground current is obtained from the phase currents by the residual current circuit.

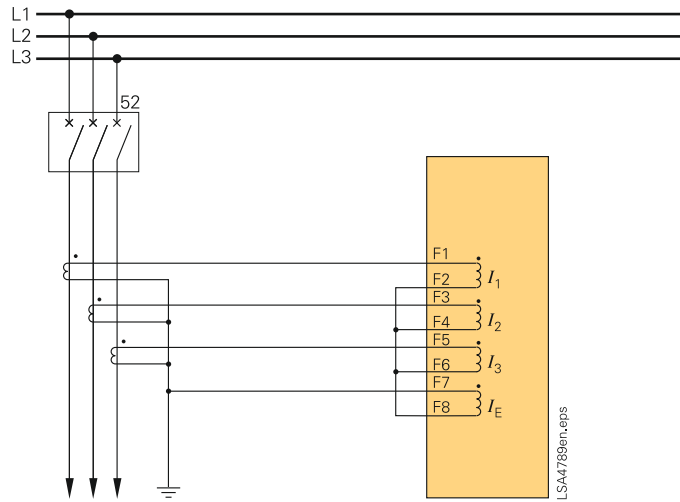

**Fig. 5/68**  
Residual current circuit without directional element

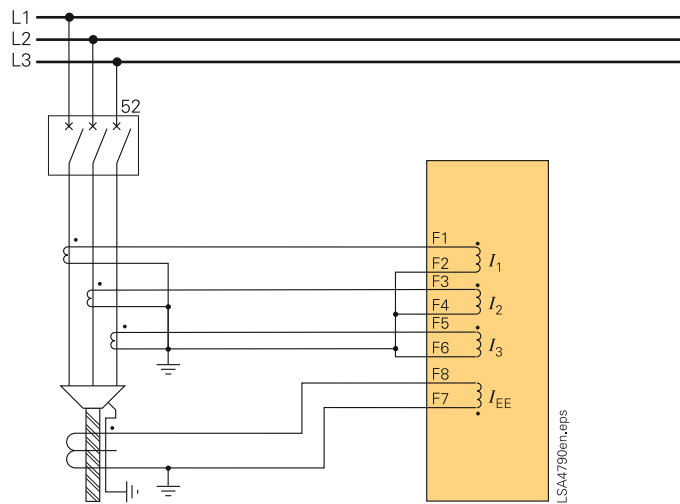

**Fig. 5/69**  
Sensitive ground-current detection without directional element

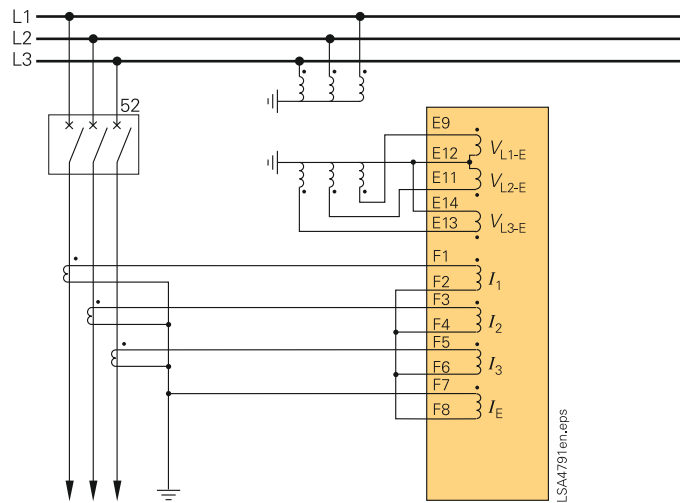

**Fig. 5/70**  
Residual current circuit with directional element

Typical connections

Connection for compensated networks

The figure shows the connection of two phase-to-ground voltages and the  $V_E$  voltage of the broken delta winding and a phase-balance neutral current transformer for the ground current. This connection maintains maximum precision for directional ground-fault detection and must be used in compensated networks.

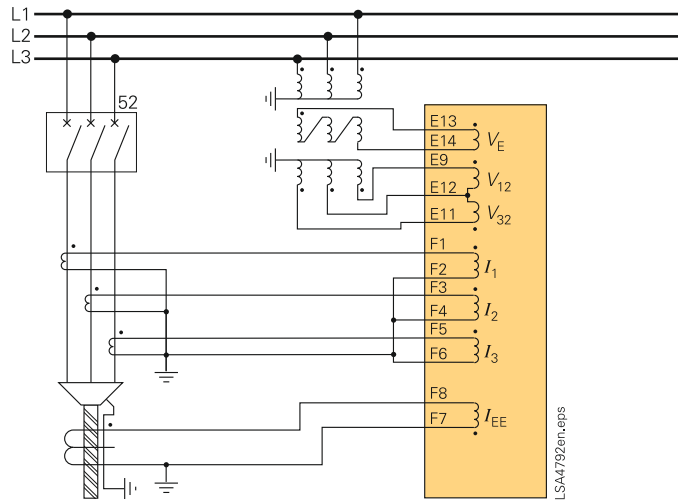


Fig. 5/71 Sensitive directional ground-fault detection with directional element for phases

Fig. 5/72 shows sensitive directional ground-fault detection.

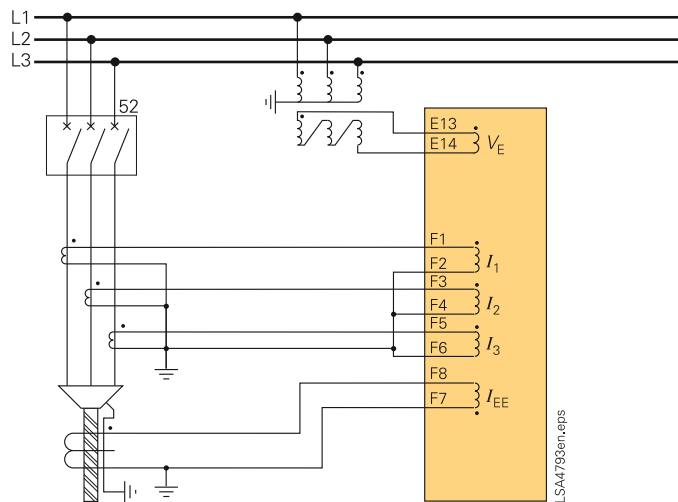


Fig. 5/72 Sensitive directional ground-fault detection

Connection for the synch-check function

Open delta voltages and residual  $I_N$  connection. Single-phase connection for synch-check.

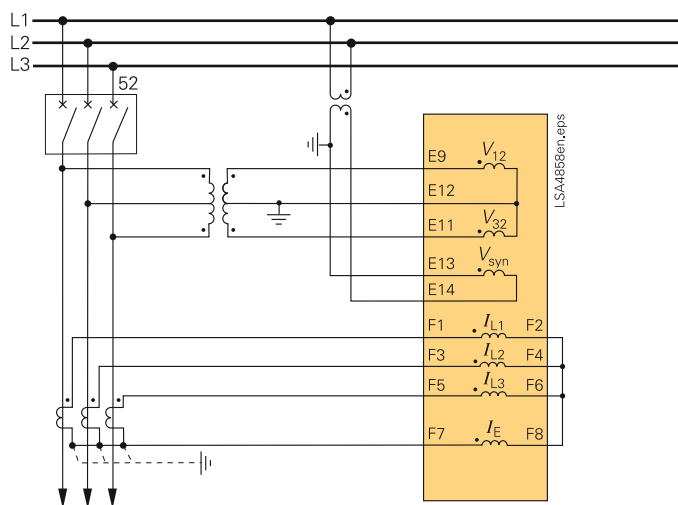


Fig. 5/73 Measuring of the busbar voltage and the outgoing feeder voltage for synchronization

## Typical applications

## Overview of connection types

Type of network	Function	Current connection	Voltage connection
(Low-resistance) grounded network	Time-overcurrent protection phase/ground non-directional	Residual circuit, with 3 phase-current transformers required, phase-balance neutral current transformer possible	–
(Low-resistance) grounded networks	Sensitive ground-fault protection	Phase-balance neutral current transformers required	–
Isolated or compensated networks	Time-overcurrent protection phases non-directional	Residual circuit, with 3 or 2 phase current transformers possible	–
(Low-resistance) grounded networks	Time-overcurrent protection phases directional	Residual circuit, with 3 phase-current transformers possible	Phase-to-ground connection or phase-to-phase connection
Isolated or compensated networks	Time-overcurrent protection phases directional	Residual circuit, with 3 or 2 phase-current transformers possible	Phase-to-ground connection or phase-to-phase connection
(Low-resistance) grounded networks	Time-overcurrent protection ground directional	Residual circuit, with 3 phase-current transformers required, phase-balance neutral current transformers possible	Phase-to-ground connection required
Isolated networks	Sensitive ground-fault protection	Residual circuit, if ground current $> 0.05 I_N$ on secondary side, otherwise phase-balance neutral current transformers required	3 times phase-to-ground connection or phase-to-ground connection with broken delta winding
Compensated networks	Sensitive ground-fault protection $\cos \varphi$ measurement	Phase-balance neutral current transformers required	3 times phase-to-ground connection or phase-to-ground connection with broken delta winding



### Technical data

#### General unit data

##### Analog current inputs

Rated frequency $f_N$	50 or 60 Hz (adjustable)
Rated current $I_{nom}$	1 or 5 A
Ground current, sensitive $I_{Ns}$	$\leq 1.6 \cdot I_{nom}$ linear range <sup>1)</sup>
Burden per phase and ground path at $I_{nom} = 1$ A at $I_{nom} = 5$ A for sensitive ground fault detection at 1 A	Approx. 0.05 VA Approx. 0.3 VA Approx. 0.05 VA
Load capacity current path Thermal (rms)	500 A for 1 s 150 A for 10 s 20 A continuous
Dynamic (peak value)	1250 A (half-cycle)
Loadability input for sensitive ground-fault detection $I_{Ns}$ <sup>1)</sup> Thermal (rms)	300 A for 1 s 100 A for 10 s 15 A continuous
Dynamic (peak value)	750 A (half-cycle)

##### Analog voltage inputs

Rated voltage	34 to 225 V (phase-to-ground connection) 34 to 200 V (phase-to-phase connection)
Measuring range	0 to 200 V
Burden at 100 V	Approx. 0.005 VA
Overload capacity in voltage path Thermal (rms)	230 V continuous
Input voltage range UL	300 V

##### Auxiliary voltage

###### DC voltage

Voltage supply via an integrated converter

Rated auxiliary voltage $V_{aux}$	DC	24 to 48 V	60 to 250 V
Permissible voltage ranges	DC	19 to 60 V	48 to 300 V
AC ripple voltage, peak-to-peak, IEC 60255-11		$\leq 15$ % of the auxiliary voltage	

###### Power input

Quiescent	Approx. 5 W
Energized	Approx. 12 W

Bridging time for failure/  
short-circuit, IEC 60255-11  
(in the quiescent state)

###### AC voltage

Voltage supply via an integrated converter

Rated auxiliary voltage $V_{aux}$	AC	115 V	230 V
Permissible voltage ranges	AC	92 to 132 V	184 to 265 V
Power input (at 115 V AC/230 V AC)			
Quiescent	Approx. 5 VA		
Energized	Approx. 12 VA		
Bridging time for failure/short- circuit (in the quiescent state)		$\geq 10$ ms at $V = 115/230$ V AC	

1) Only in models with input for sensitive ground-fault detection (see ordering data)

#### Binary inputs

Type	7SJ801/803	7SJ802/804
Number (marshallable)	3	7
Rated voltage range	24 to 250 V DC	
Current input, energized (independent of the control voltage)	Approx. 0.4 mA	
Secured switching thresholds	(adjustable)	
for rated voltages 24 to 125 V DC	$V_{high} > 19$ V DC $V_{low} < 10$ V DC	
for rated voltages 110 to 250 V DC	$V_{high} > 88$ V DC $V_{low} < 44$ V DC	
for rated voltages 220 and 250 V DC	$V_{high} > 176$ V DC $V_{low} < 88$ V DC	
Maximum permissible voltage	300 V DC	
Input interference suppression	220 V DC across 220 nF at a recovery time between two switching operations $\geq 60$ ms	

#### Output relay

Type	7SJ801/803	7SJ802/804
NO contact	3	6
NO/NC selectable	2 (+ 1 live contact not allocatable) 2 (+ 1 live contact not allocatable)	
Switching capability	MAKE	Max. 1000 W/VA
Switching capability	BREAK	40 W or 30 VA at $L/R \leq 40$ ms
Switching voltage	250 V DC/AC	
Admissible current per contact (continuous)	5 A	
Permissible current per contact (close and hold)	30 A for 1 s (NO contact)	

#### Electrical tests

##### Specification

Standards	IEC 60255 (product standard) ANSI/ IEEE C37.90 see individual functions VDE 0435 for more standards see also individual functions
-----------	--

##### Insulation tests

Standards	IEC 60255-27 and IEC 60870-2-1
High-voltage test (routine test) All circuits except power supply, binary inputs, communication interface	2.5 kV, 50 Hz
High-voltage test (routine test) Auxiliary voltage and binary inputs	3.5 kV DC
High-voltage test (routine test) Only isolated communication interfaces (A and B)	500 V, 50 Hz
Impulse voltage test (type test) All process circuits (except commu- nication interfaces) against the inter- nal electronics	6 kV (peak value); 1.2/50 $\mu$ s; 0.5 J; 3 positive and 3 negative impulses at intervals of 1 s

## Technical data

## Insulation tests (cont'd)

Impulse voltage test (type test) All process circuits (except communication interfaces) against each other and against the productive conductor terminal class III	5 kV (peak value); 1.2/50 $\mu$ s; 0.5 J; 3 positive and 3 negative impulses at intervals of 1 s
---	---

## EMC tests for immunity; type tests

Standards	IEC 60255-6 and -22 (product standard) IEC/EN 61000-6-2 VDE 0435 For more standards see individual functions
1 MHz check, class III IEC 60255-22-1; IEC 61000-4-18; IEEE C37.90.1	2.5 kV (peak); 1 MHz; $\tau = 15 \mu$ s; 400 surges per s; test duration 2 s; $R_i = 200 \Omega$
Electrostatic discharge, class IV IEC 60255-22-2 and IEC 61000-4-2	8 kV contact discharge; 15 kV air discharge; both polarities; 150 pF; $R_i = 330 \Omega$
Radio frequency electromagnetic field, amplitude-modulated, class III IEC 60255-22-3; or IEC 61000-4-3	10 V/m; 80 MHz to 2.7 GHz; 80 % AM; 1 kHz
Fast transient disturbance variables/ burst, class IV IEC 60255-22-4 and IEC 61000-4-4, IEEE C37.90.1	4 kV; 5/50 ns; 5 kHz; burst length = 15 ms; repetition rate 300 ms; both polarities; $R_i = 50 \Omega$ ; test duration 1 min
High-energy surge voltages (SURGE), Installation class III IEC 60255-22-5; IEC 61000-4-5 Auxiliary voltage	Impulse: 1.2/50 $\mu$ s  Common mode: 4 kV; 12 $\Omega$ ; 9 $\mu$ F Diff. mode: 1 kV; 2 $\Omega$ ; 18 $\mu$ F
Measuring inputs, binary inputs and relay outputs	Common mode: 4 kV; 42 $\Omega$ ; 0.5 $\mu$ F Diff. mode: 1 kV; 42 $\Omega$ ; 0.5 $\mu$ F
HF on lines, amplitude-modulated, class III; IEC 60255-22-6; IEC 61000-4-6,	10 V; 150 kHz to 80 MHz; 80 % AM; 1 kHz
Power system frequency magnetic field IEC 61000-4-8, class IV	30 A/m continuous; 300 A/m for 3 s
Radiated electromagnetic interference ANSI/IEEE C37.90.2	20 V/m; 80 MHz to 1 GHz; 80 % AM; 1 kHz
Damped oscillations IEC 61000-4-18	2.5 (peak value) 100 kHz; 40 pulses per s; test duration 2 s; $R_i = 200 \Omega$

## EMC tests for noise emission; type tests

Standard	IEC/EN 61000-6-4
Radio noise voltage to lines, only auxiliary voltage IEC/CISPR 11	150 kHz to 30 MHz, limit class A
Interference field strength IEC/CISPR 11	30 to 1000 MHz, limit class A

## Mechanical stress tests

## Vibration, shock stress and seismic vibration

## During stationary operation

Standards	IEC 60255-21 and IEC 60068
Oscillation IEC 60255-21-1, class II; IEC 60068-2-6	Sinusoidal 10 to 60 Hz: $\pm 0.075$ mm amplitude; 60 to 150 Hz: 1 g acceleration Frequency sweep rate 1 octave/min 20 cycles in 3 orthogonal axes

Shock IEC 60255-21-2, class I; IEC 60068-2-27	Semi-sinusoidal 5 g acceleration, duration 11 ms; each 3 shocks (in both directions of 3 axes)
Seismic vibration IEC 60255-21-3, class II; IEC 60068-3-3	Sinusoidal 1 to 8 Hz: $\pm 7.5$ mm amplitude (horizontal axis) 1 to 8 Hz: $\pm 3.5$ mm amplitude (vertical axis) 8 to 35 Hz: 2 g acceleration (horizontal axis) 8 to 35 Hz: 1 g acceleration (vertical axis) Frequency sweep 1 octave/min 1 cycle in 3 orthogonal axes
<b>During transport</b>	
Standards	IEC 60255-21 and IEC 60068
Vibration IEC 60255-21-1, class II; IEC 60068-2-6	Sinusoidal 5 to 8 Hz: $\pm 7.5$ mm amplitude 8 to 150 Hz; 2 g acceleration Frequency sweep 1 octave/min 20 cycles in 3 orthogonal axes
Shock IEC 60255-21-2, class I; IEC 60068-2-27	Semi-sinusoidal 15 g acceleration, duration 11 ms, each 3 shocks (in both directions of the 3 axes)
Continuous shock IEC 60255-21-2, class I; IEC 60068-2-29	Semi-sinusoidal 10 g acceleration, duration 16 ms, each 1000 shocks (in both directions of the 3 axes)

## Climatic stress tests

## Temperatures

Standards	IEC 60255-6
Type test (in acc. with IEC 60068-2-1 and -2, Test Bd for 16 h)	-25 °C to +85 °C or -13 °F to +185 °F
Permissible temporary operating temperature (tested for 96 h)	-20 °C to +70 °C or -4 °F to +158 °F (clearness of the display may be impaired from +55 °C or +131 °F)
Recommended for permanent operation (in acc. with IEC 60255-6)	-5 °C to +55 °C or +23 °F to +131 °F
Limit temperatures for storage	-25 °C to +55 °C or -13 °F to +131 °F
Limit temperatures for transport	-25 °C to +70 °C or -13 °F to +158 °F
Storage and transport with factory packaging	

## Humidity

Permissible humidity	Mean value per year $\leq 75$ % relative humidity; on 56 days of the year up to 93 % relative humidity; condensa- tion must be avoided!
----------------------	--

It is recommended that all devices be installed such that they are not exposed to direct sunlight, nor subject to large fluctuations in temperature that may cause condensation to occur.

## Unit design

Type	7SJ80**-*B	7SJ80**-*E
Housing	7XP20	
Dimensions	See dimension drawings	
Housing width	1/6	1/6
Weight in kg		
Surface-mounting	4.5 kg (9.9 lb)	
Flush-mounting	4 kg (8.8 lb)	



## Technical data

### Unit design (cont'd)

Degree of protection acc. to EN 60529	
For equipment in the surface-mounting housing	IP 50
For equipment in the flush-mounting housing	Front IP 51 Back IP 50
For operator protection	IP 2x for current terminal IP 1x for voltage terminal
Degree of pollution, IEC 60255-27	2

### Communication interfaces

#### Operating interface (front of unit)

Terminal	USB, type B
Transmission speed	Up to 12 Mbit/s
Bridgeable distance	5 m

#### Ethernet service interface (Port A)

##### Ethernet electrical for DIGSI

Operation	With DIGSI
Terminal	At the bottom part of the housing, mounting location "A", RJ45 socket, 100BaseT in acc. with IEEE 802.3 LED yellow: 10/100 Mbit/s (ON/OFF) LED green: connection/no connection (ON/OFF)
Test voltage	500 V/50 Hz
Transmission speed	10/100 Mbit/s
Bridgeable distance	20 m (66 ft)

#### Service interface for DIGSI 4/modem (Port B)

##### Isolated RS 232/RS 485

Terminal	At the bottom part of the housing, 9-pin subminiature connector (SUB-D)
Test voltage	500 V/50 Hz
Transmission rate	Min. 1200 Bd, max. 115200 Bd
Bridgeable distance RS232	Max. 15 m/49.2 ft
Bridgeable distance RS485	Max. 1 km/3300 ft

##### Fiber optic (FO)

Terminal	At the bottom part of the housing, ST connector
Optical wavelength	$\lambda = 820$ nm
Permissible path attenuation	Max. 8 dB, for glass fiber 62.5/125 $\mu$ m
Bridgeable distance	Max. 1.5 km/0.9 miles

#### System interface (Port B)

##### IEC 60870-5-103 protocol, single

##### RS 232/RS 485

Terminal	At the bottom part of the housing, mounting location "B", 9-pin subminiature connector (SUB-D)
Test voltage	500 V/50 Hz
Transmission rate	Min. 1200 Bd, max. 115000 Bd, factory setting 9600 Bd
Bridgeable distance RS232	15 m/49.2 ft
Bridgeable distance RS485	1 km/3300 ft

#### System interface

##### IEC 60870-5-103 protocol, single (continued)

##### Fiber optic

Connection fiber-optic cable	ST connector
Terminal	At the bottom part of the housing, mounting location "B"
Optical wavelength	$\lambda = 820$ nm
Permissible path attenuation	Max. 8 dB, for glass fiber 62.5/125 $\mu$ m
Bridgeable distance	Max. 1.5 km/0.9 miles

##### IEC 60870-5-103 protocol, redundant

##### RS485, isolated

Terminal	At the bottom part of the housing, mounting location "B", RJ45 socket
Test voltage	500 V/50 Hz
Transmission rate	Min. 2400 Bd, max. 57600 Bd; factory setting 19200 Bd
Bridgeable distance RS485	Max. 1 km/3300 ft

##### IEC 61850 protocol

##### Ethernet, electrical (EN100) for IEC 61850 and DIGSI

Terminal	At the bottom part of the housing, mounting location "B", two RJ45 connectors, 100BaseT in acc. with IEEE 802.3
Test voltage	500 V/50 Hz
Transmission rate	100 Mbit/s
Bridgeable distance	Max. 20 m/65.6 ft

##### Ethernet, optical (EN100) for IEC 61850 and DIGSI

Terminal	At the bottom part of the housing, mounting location "B", LC connector, 100BaseT in acc. with IEEE 802.3
Transmission rate	100 Mbit/s
Optical wavelength	$\lambda = 1300$ nm
Bridgeable distance	max. 2 km/1.24 miles

##### PROFIBUS DP

##### RS485, isolated

Terminal	At the bottom part of the housing, mounting location "B", 9-pin subminiature connector (SUB-D)
Test voltage	500 V/50 Hz
Transmission rate	Up to 1.5 Mbaud
Bridgeable distance	1000 m/3300 ft $\leq$ 93.75 kbaud; 500 m/1640 ft $\leq$ 187.5 kbaud; 200 m/656 ft $\leq$ 1.5 Mbaud

##### Fiber optic

Connection fiber-optic cable	ST connector, double ring
Terminal	At the bottom part of the housing, mounting location "B"
Optical wavelength	$\lambda = 820$ nm
Permissible path attenuation	Max. 8 dB, for glass fiber 62.5/125 $\mu$ m
Bridgeable distance	Max. 2 km/1.24 miles

##### MODBUS RTU, DNP 3.0

##### RS485

Terminal	At the bottom part of the housing, mounting location "B", 9-pin subminiature connector (SUB-D)
Test voltage	500 V/50 Hz

## Technical data

## System interface (cont'd)

Transmission rate	Up to 19200 baud
Bridgeable distance	Max. 1 km/3300 ft
<u>Fiber optic</u>	
Connection fiber-optic cable	ST connector transmitter/receiver
Terminal	At the bottom part of the housing, mounting location "B"
Optical wavelength	$\lambda = 820$ nm
Permissible path attenuation	Max. 8 dB, for glass fiber 62.5/125 $\mu\text{m}$
Bridgeable distance	Max. 1.5 km/0.9 miles

## Functions

## Definite-time overcurrent protection, directional/non-directional (ANSI 50, 50N, 67, 67N)

Operating modes	3-phase (standard) or 2-phase A (L1) and C (L3)
Number of elements (stages)	50-1, 50-2, 50-3 ( $I>$ , $I>>$ , $I>>>$ ) (phases) 50N-1, 50N-2, 50N-3 ( $I_E>$ , $I_E>>$ , $I_E>>>$ ) (ground)
Setup setting ranges	
Pickup current	0.5 to 175 A or $\infty^1$ (in steps of 0.01 A)
50-1, 50-2, 50-3 (phases)	
Pickup current	0.25 to 175 A or $\infty^1$ (in steps of 0.01 A)
50N-1, 50N-2, 50N-3 (ground)	
Delay times $T$	0 to 60 s or $\infty$ (in steps of 0.01 s)
Dropout delay time 50/50N	0 to 60 s (in steps of 0.01 s)
$T_{\text{DROPOUT (DO)}}$	
Times	
Pickup times (without inrush restraint, with inrush restraint + 10 ms)	
With twice the setting value	Approx. 30 ms
With ten times the setting value	Approx. 20 ms
Dropout time	Approx. 30 ms
Dropout ratio	Approx. 0.95 for $I/I_{\text{nom}} \geq 0.3$
Tolerances	
Pickup	3 % of setting value or 75 mA <sup>1)</sup>
Delay times $T$ , $T_{\text{DO}}$	1 % or 10 ms

## Inverse-time overcurrent protection, directional/non-directional (ANSI 51, 51N, 67, 67N)

Operating mode	3-phase (standard) or 2-phase A (L1) and C (L3)
Setting ranges	
Pickup currents 51 (phases)/( $I_P$ )	0.5 to 20 A <sup>1)</sup> (in steps of 0.01 A)
Pickup currents 51N (ground)/( $I_{EP}$ )	0.25 to 20 A <sup>1)</sup> (in steps of 0.01 A)
Time multiplier $T$ for 51, 51N ( $I_P$ , $I_{EP}$ ) (IEC characteristics)	0.05 to 3.2 s or $\infty$ (in steps of 0.01 s)
Time multiplier $D$ for 51, 51N (ANSI characteristics)	0.50 to 15 s or $\infty$ (in steps of 0.01 s)
Trip characteristics	
IEC	Inverse (type A), very inverse (type B), extremely inverse (type C), long inverse (type B)
acc. to IEC 60255-3 or BS 142	
ANSI/IEEE	Inverse, short inverse, long inverse, moderately inverse, very inverse, extremely inverse, definite inverse

1) At  $I_{\text{nom}} = 1$  A, all limits divided by 5.

Dropout characteristics with disk emulation	
IEC	Inverse (type A), very inverse (type B), extremely inverse (type C), long inverse (type B)
acc. to IEC 60255-3 or BS 142	
ANSI/IEEE	Inverse, short inverse, long inverse, moderately inverse, very inverse, extremely inverse, definite inverse
Pickup threshold IEC and ANSI	Approx. $1.1 \cdot I_P$
Dropout setting IEC and ANSI	
Without disk emulation	Approx. $1.05 \cdot I_P$ setting value for $I_P/I_{\text{nom}} \geq 0.3$ , corresponds to approx. $0.95 \cdot$ pickup value
With disk emulation	Approx. $0.9 \cdot I_P$ setting value
Tolerances	
Pickup/dropout thresholds $I_P$ , $I_{EP}$	3 % of setting value or 75 mA <sup>1)</sup>
Trip time for $2 \leq I/I_P \leq 20$	5 % of reference (calculated) value + 2 % current tolerance or 30 ms
Dropout time for $I/I_P \leq 0.9$	5 % of reference (calculated) value + 2 % current tolerance or 30 ms

## Determination of direction

## For phase faults

Polarization/type	With cross-polarized voltages With voltage memory (memory depth 2 seconds) for measurement voltages that are too low
Forward range	$V_{\text{ref,rot}} \pm 86^\circ$
Rotation of reference voltage $V_{\text{ref,rot}}$	$-180^\circ$ to $180^\circ$ (in steps of $1^\circ$ )
Directional sensitivity	For one and two-phase faults unlimited For three-phase faults dynamically unlimited Steady-state approx. 7 V phase-to-phase

## For ground faults

Polarization/type	With zero-sequence quantities $3V_0$ , $3I_0$ or with negative-sequence quantities $3V_2$ , $3I_2$
Forward range	$V_{\text{ref,rot}} \pm 86^\circ$
Rotation of reference voltage $V_{\text{ref,rot}}$	$-180^\circ$ to $180^\circ$ (in steps of $1^\circ$ )
Directional sensitivity	Zero-sequence quantities $3V_0$ , $3I_0$
	$V_N \approx 2.5$ V displacement voltage, measured $3V_0 \approx 5$ V displacement voltage, calculated $3V_2 \approx 5$ V negative-sequence voltage $3I_2 \approx 225$ mA negative-sequence current <sup>1)</sup>
Times	
Pickup times (without inrush restraint; with inrush restraint + 10 ms)	50-1, 50-2, 50N-1, 50N-2
With twice the setting value	Approx. 45 ms
With ten times the setting value	Approx. 40 ms
Dropout time 50-1, 50-2, 50N-1, 50N-2	Approx. 40 ms
Tolerances	
Angle faults for phase and earth faults	$\pm 3^\circ$ electrical

## Technical data

**Inrush restraint**

Controlled functions	Time-overcurrent elements, $I>$ , $I_{E>}$ , $I_p$ , $I_{Ep}$ (directional, non-directional) 50-1, 50N-1, 51, 51N, 67-1, 67N-1
Lower function limit	At least one phase current (50 Hz and 100 Hz) $\geq 125$ mA for $I_{nom} = 5$ A, $\geq 50$ mA for $I_{nom} = 1$ A
Upper function limit (setting range)	1.5 to 125 A <sup>1)</sup> (in steps of 0.01 A)
Setting range, stabilization factor $I_{2f}/I$	10 to 45 % (in steps of 1 %)
Crossblock $I_{A(L1)}$ , $I_{B(L2)}$ , $I_{C(L3)}$	ON/OFF

**Cold-load pickup/dynamic setting change**

Controllable functions	Directional and non-directional time-overcurrent protection (separated acc. to phases and ground)
Initiation criteria	Current criterion "BkrClosed/MIN" CB position via aux. contacts, binary input, auto-reclosure ready
Time control	3 time elements ( $T_{CB\ Open}$ , $T_{Active}$ , $T_{Stop}$ )
Current control	Current threshold "BkrClosed/MIN" (reset on dropping below threshold; monitoring with timer)
Setting ranges	
Current control	0.2 to 5 A <sup>1)</sup> (in steps of 0.01 A)
Time until changeover to dynamic setting $T_{CB\ Open}$	0 to 21600 s (= 6 h) (in steps of 1 s)
Period dynamic settings are effective after a reclosure $T_{Active}$	1 to 21600 s (= 6 h) (in steps of 1 s)
Fast reset time $T_{Stop}$	1 to 600 s (= 10 min.) or $\infty$ (fast reset inactive) (in steps of 1 s)
Dynamic settings or pickup currents and time delays or time multipliers	Adjustable within the same ranges and with the same steps (increments) as the directional and non-directional time-overcurrent protection

**Single-phase overcurrent protection****Current elements**

High-set current elements 50-2 ( $I>>$ )	0.005 to 8 A (in steps of 0.001 A) or $\infty$ <sup>1)</sup> (disabled)
Definite-time current element 50-1 ( $I>$ )	0.005 to 8 A or $\infty$ <sup>1)</sup> (disabled) (in steps of 0.001 A)
$T_{50-1}$ , $T_{50-2}$ ( $T_I>/T_I>>$ )	0 to 60 s or $\infty$ (no trip) (in steps of 0.01 s)
Operating times	
Minimum	14 ms
Typical	30 ms
Dropout time	Approx. 25 ms
Dropout ratios	
Current elements	Approx. 0.95 for $I/I_{nom} \geq 0.5$
Tolerances	
Currents	5 % of setting value or 1 mA
Times	1 % of setting value or 10 ms

**Voltage protection (ANSI 27, 59)****Undervoltages 27-1, 27-2 ( $V<$ ,  $V<<$ )**

Measured quantity used with Three-phase connection	Positive-sequence system of the voltages Lowest phase-to-phase voltage Lowest phase-to-ground voltage
Single-phase connection	Connected single-phase-to-ground voltage

1) At  $I_{nom} = 1$  A, all limits divided by 5. 2)  $r = V_{dropout}/V_{pickup}$ .

Setting ranges	
Connection of phase-to-ground voltage	10 to 120 V (in steps of 1 V)
Connection of phase-to-phase voltage	10 to 120 V (in steps of 1 V)
Connection of single phase Dropout ratio <sup>2)</sup> $r$ for 27-1, 27-2 ( $V<$ , $V<<$ )	10 to 120 V (in steps of 1 V) 1.01 to 3 (in steps of 0.01)
Dropout threshold for $r \cdot 27-1$ ( $V<$ ) $r \cdot 27-2$ ( $V<<$ )	Max. 130 V for phase-to-phase voltage Max. 225 V for phase-to-ground volt.
Hysteresis	Min. 0.6 V
Time delays $T27-1$ ( $V<$ ), $T27-2$ ( $V<<$ )	0 to 100 s (in steps of 0.01 s) or $\infty$ (disabled)
Current criterion "BkrClosed/MIN"	0.2 to 5 A <sup>1)</sup> (in steps of 0.01 A)
<b>Overvoltages 59-1, 59-2 (<math>V&gt;</math>, <math>V&gt;&gt;</math>)</b>	
Measured quantity used with Three-phase connection	Positive-sequence system of the voltages Negative-sequence system of the voltages Highest phase-to-phase voltage Highest phase-to-ground voltage
Single-phase connection	Connected single-phase-to-ground voltage
Setting ranges	
Connection of phase-to-ground voltage:	
Evaluation of phase-to-ground voltages	20 to 150 V (in steps of 1 V)
Evaluation of phase-to-phase voltages	20 to 260 V (in steps of 1 V)
Evaluation of positive-sequence system	20 to 150 V (in steps of 1 V)
Evaluation of negative-sequence system	2 to 150 V (in steps of 1 V)
Connection of phase-to-phase voltages:	
Evaluation of phase-to-phase voltage	20 to 150 V (in steps of 1 V)
Evaluation of positive-sequence system	20 to 150 V (in steps of 1 V)
Evaluation of negative-sequence system	2 to 150 V (in steps of 1 V)
Connection single phase Dropout ratio $r$ for 59-1, 59-2 ( $V>$ , $V>>$ )	20 to 150 V (in steps of 1 V) 0.90 to 0.99 (in steps of 0.01 V)
Dropout threshold for $r \cdot 59-1$ ( $V>$ ) $r \cdot 59-2$ ( $V>>$ )	Max. 150 V for phase-to-phase voltage Max. 260 V for phase-to-ground volt.
Hysteresis	Min. 0.6 V
Time delay $T59-1$ , $T59-2$ ( $V>$ , $V>>$ )	0 to 100 s (in steps of 0.01 s) or $\infty$ (disabled)
Times	
Pickup times	
Undervoltage 27-1, 27-2 ( $V<$ , $V<<$ ) 27-1 $V_1$ , 27-2 $V_1$	Approx. 50 ms
Overvoltage 59-1, 59-2 ( $V>$ , $V>>$ ) Overvoltage 59-1 $V_1$ , 59-2 $V_1$ , 59-1 $V_2$ , 59-2 $V_2$	Approx. 50 ms Approx. 60 ms
Dropout times	
Undervoltage 27-1, 27-2 ( $V<$ , $V<<$ ) 27-1 $V_1$ , 27-2 $V_1$	Approx. 50 ms
Overvoltage 59-1, 59-2 ( $V>$ , $V>>$ ) Overvoltage 59-1 $V_1$ , 59-2 $V_1$ , 59-1 $V_2$ , 59-2 $V_2$	Approx. 50 ms Approx. 60 ms
Tolerances	
Pickup voltage limits	3 % of setting value or 1 V
Delay times $T$	1 % of setting value or 10 ms

## Technical data

**Negative-sequence protection (ANSI 46)****Definite-time characteristic (ANSI 46-1 and 46-2)**

Setting ranges	
Unbalanced load tripping element 46-1, 46-2 ( $I_2>$ , $I_2>>$ )	0.5 to 15 A or $\infty$ (disabled) <sup>1)</sup> (in steps of 0.01 A)
Delay times 46-1, 46-2 ( $T_{I_2>}$ , $T_{I_2>>}$ )	0 to 60 s or $\infty$ (disabled) <sup>1)</sup> (in steps of 0.01 s)
Dropout delay times 46 $T_{Dropout}$	0 to 60 s (in steps of 0.01 s)
Functional limit	All phase currents $\leq 50 A$ <sup>1)</sup>
Times	
Pickup times	Approx. 35 ms
Dropout times	Approx. 35 ms
Dropout ratio	
Characteristic 46-1, 46-2/ $I_2>$ , $I_2>>$	Approx. 0.95 for $I_2/I_{nom} \geq 0.3$
Tolerances	
Pickup values 46-1, 46-2/ $I_2>$ , $I_2>>$	3 % of the set value or 75 mA <sup>1)</sup>
Delay times	1 % or 10 ms
<b>Inverse-time characteristic (ANSI 46-TOC)</b>	
Setting ranges	
Pickup value 46-TOC/ $I_{2p}$	0.5 to 10 A <sup>1)</sup> (in steps of 0.01 A)
Time multiplier $T_{I_{2p}}$ (IEC)	0.05 to 3.2 s or $\infty$ (disabled) (in steps of 0.01 s)
Time multiplier $D_{I_{2p}}$ (ANSI)	0.5 to 15 s or $\infty$ (disabled) (in steps of 0.01 s)
Functional limit	All phase currents $\leq 50 A$ <sup>1)</sup>
Trip characteristics acc. to IEC	Inverse, very inverse, extremely inverse
ANSI	Inverse, moderately inverse, very inverse, extremely inverse
Pickup threshold IEC and ANSI	Approx. $1.10 \cdot I_{2p}$
Tolerances	
Pickup threshold $I_{2p}$	3 % of the setting value or 75 mA <sup>1)</sup>
Time for $2 \leq I/I_{2p} \leq 20$	5 % of reference (calculated) value + 2 % current tolerance or 30 ms
Dropout characteristic with disk emulation acc. to ANSI	Inverse, moderately inverse, very inverse, extremely inverse
Dropout value	
IEC and ANSI without disk emulation	Approx. $1.05 \cdot I_{2p}$ setting value, corresponds to approx. $0.95 \cdot$ pickup
ANSI with disk emulation	Approx. $0.90 \cdot I_{2p}$ setting value
Tolerances	
Dropout value $I_{2p}$	3 % of the set value or 75 mA <sup>1)</sup>
Time for $2 \leq I_2/I_{2p} \leq 0.90$	5 % of reference (calculated) value + 2 % current tolerance, or 30 ms

**Frequency protection (ANSI 81O/U)**

Number of frequency elements	4, each can be set to $f>$ or $f<$
Setting ranges	
Pickup values $f>$ or $f<$ for $f_{nom} = 50$ Hz	40 to 60 Hz (in steps of 0.01 Hz)
Pickup values $f>$ or $f<$ for $f_{nom} = 60$ Hz	50 to 70 Hz (in steps of 0.01 Hz)
Delay times $T$	0 to 100 s or $\infty$ (disabled) (in steps of 0.01 s)
Undervoltage blocking, with positive-sequence voltage $V_1$	10 to 150 V (in steps of 1 V)

1) At  $I_{nom} = 1 A$ , all limits divided by 5.

Times	
Pickup times $f>$ , $f<$	Approx. 80 ms
Dropout times $f>$ , $f<$	Approx. 80 ms
Dropout difference	
$\Delta f =  \text{pickup value} - \text{dropout value} $	0.02 to 1 Hz
Dropout	
Ratio undervoltage blocking	Approx. 1.05
Tolerances	
Pickup thresholds	
Frequency 81O/U $f>$ , $f<$	15 mHz (with $V = V_{nom}$ , $f = f_{nom}$ )
Undervoltage blocking	3 % of setting value or 1 V
Delay times	1 % of the setting value or 10 ms
<b>Thermal overload protection (ANSI 49)</b>	
Setting ranges	
Factor k	0.1 to 4 (in steps of 0.01)
Time constant	1 to 999.9 min (in steps of 0.1 min)
Current warning stage $I_{Alarm}$	0.5 to 20 A (in steps of 0.01 A)
Extension factor when stopped $k_r$ factor	1 to 10 with reference to the time constant with the machine running (in steps of 0.1)
Dropout ratios	
$\Theta/\Theta_{Trip}$	Drops out with $\Theta_{Alarm}$
$\Theta/\Theta_{Alarm}$	Approx. 0.99
$I/I_{Alarm}$	Approx. 0.97
Tolerances	
With reference to $k \cdot I_{nom}$	3 % or 75 mA <sup>1)</sup> 2 % class acc. to IEC 60255-8
With reference to tripping time	3 % or 1 s for $I/(k \cdot I_{nom}) > 1.25$ 3 % class acc. to IEC 60255-8
<b>(Sensitive) ground-fault protection (ANSI 59N/64, 50Ns, 51Ns, 67Ns)</b>	
<b>Displacement voltage element for all types of ground fault (ANSI 59N/64)</b>	
Setting ranges	
Displacement voltage (measured)	$V_0 > 1.8$ to 200 V (in steps of 0.1 V)
Displacement voltage (calculated)	$3V_0 > 10$ to 225 V (in steps of 0.1 V)
Delay time $T_{Delay pickup}$	0.04 to 320 s or $\infty$ (in steps of 0.01 s)
Additional trip delay $T_{V Delay}$	0.1 to 40,000 s or $\infty$ (in steps of 0.01 s)
Operating time	Approx. 50 ms
Dropout ratio	0.95 or (pickup value $-0.6 V$ )
Tolerances (measurement)	
Pickup threshold $V_0$ (measured)	3 % of setting value or 0.3 V
Pickup threshold $3V_0$ (calculated)	3 % of setting value or 3 V
Delay times	1 % of setting value or 10 ms
<b>Phase detection for ground fault in an ungrounded system</b>	
Measuring principle	Voltage measurement (phase-to-ground)
Setting ranges	
$V_{ph min}$ (ground-fault phase)	10 to 100 V (in steps of 1 V)
$V_{ph max}$ (healthy phases)	10 to 100 V (in steps of 1 V)
Tolerance	3 % of setting value or 1 V
Measurement tolerance acc. to VDE 0435, Part 303	

## Technical data

**(Sensitive) ground-fault protection (ANSI 59N/64, 50Ns, 51Ns, 67Ns) (cont'd)****Ground-fault pickup for all types of ground faults****Definite-time characteristic (ANSI 50Ns)**

Setting ranges	
Pickup current 50Ns-2 Pickup, 50Ns-1 Pickup; ( $I_{EE>}$ , $I_{EE>>}$ )	
For sensitive 5-A-transformer	0.005 to 8 A <sup>1)</sup> (in steps of 0.005 A)
For normal 5-A-transformer	0.25 to 175 A <sup>1)</sup> (in steps of 0.05 A)
Delay times $T$ for 50Ns-2 Delay, 50Ns-1 Delay ( $T_{IEE>}$ , $T_{IEE>>}$ )	0 to 320 s $\infty$ (disabled) (in steps of 0.01 A)
Dropout delay time $T_{Dropout}$	0 to 60 s (in steps of 0.01 s)
Operating times	$\leq 50$ ms (directional/non-directional)
Dropout ratio	Approx. 0.95 for 50Ns/ $I_{EE} > 50$ mA
Tolerances (measurement)	
Pickup threshold	
For sensitive 5-A-transformer	3 % of setting value or 5 mA <sup>1)</sup>
For normal 5-A-transformer	Approx. 20 % for setting values $< 10$ mA
Delay times	3 % of setting value or 75 mA <sup>1)</sup>
	1 % of setting value or 10 ms

**Ground-fault pickup for all types of ground faults****Inverse-time characteristic (ANSI 51Ns)**

User-defined characteristic	Defined by a maximum of 20 pairs of current and delay time values, directional measurement method "cos phi and sin phi"
Setting ranges	
Pickup current 51Ns; $I_{IEP}$	
For sensitive 5-A-transformer	0.005 A to 7 A <sup>1)</sup> (in steps of 0.005 A)
For normal 5-A-transformer	0.25 to 20 A <sup>1)</sup> (in steps of 0.05 A)
Time multiplier $T_{51Ns}$ , $I_{IEP}$	0.1 to 4 s or $\infty$ (disabled) (in steps of 0.01 s)
Pickup threshold	Approx. $1.1 \cdot I_{51Ns} / 1.1 \cdot I_{IEP}$
Dropout ratio	Approx. $1.05 \cdot I_{51Ns} / 1.05 \cdot I_{IEP}$ for $I_{51Ns}$ ( $I_{IEP}$ ) $> 50$ mA
Tolerances	
For sensitive 5-A-transformer	3 % of setting value or 5 mA <sup>1)</sup>
For normal 5-A-transformer	Approx. 20 % for setting values $< 10$ mA
Operating time tolerance in linear range	3 % of setting value or 75 mA <sup>1)</sup>
	7 % of reference (calculated) value for $2 \leq I/I_{51Ns}$ ( $I_{IEP}$ ) $\leq 20 + 2$ % current tolerance, or 70 ms

**Direction determination for all types of ground-faults (ANSI 67Ns)****Measuring method "cos  $\varphi$ /sin  $\varphi$ "**

Direction measurement	$I_N$ and $V_N$ measured or $3I_0$ and $3V_0$ calculated
Measuring principle	Active/reactive power measurement
Setting ranges	
Measuring enable $I_{Release}$ direct. (current component perpendicular (90°) to directional limit line)	
For sensitive 5-A-transformer	0.005 to 8 A <sup>1)</sup> (in steps of 0.005 A)
For normal 5-A-transformer	0.25 to 175 A <sup>1)</sup> (in steps of 0.05 A)
Dropout ratio	Approx. 0.8
Direction phasor $\varphi_{Correction}$	-45° to +45° (in steps of 0.1°)
Dropout delay $T_{Reset}$ delay	1 to 60 s (in steps of 1 s)

Note: When using the sensitive transformer, the linear range of the measuring input for sensitive ground fault detection is from 0.001 A to 1.6 A or 0.005 A to 8 A. The function is however still preserved for higher currents.

**Measuring method " $\varphi$  ( $V_0/I_0$ )"**

Direction measurement	$I_N$ and $V_N$ measured or $3I_0$ and $3V_0$ calculated
Minimum voltage $V_{min}$ . $V_0$ measured	0.4 to 50 V (in steps of 0.1 V)
$3V_0$ calculated	10 to 90 V (in steps of 1 V)
Phase angle 50Ns $\varphi$	-180° to 180° (in steps of 0.1°)
Delta phase angle 50Ns $\Delta \varphi$	0° to 180° (in steps of 0.1°)
<b>Angle correction for cable CT</b>	
Angle correction F1, F2 (for resonant grounded system)	0° to 5° (in steps of 0.1°)
Current value $I_1$ , $I_2$ for angle correction	
For sensitive 5-A-transformer	0.005 to 8 A <sup>1)</sup> (in steps of 0.005 A)
For normal 5-A-transformer	0.25 to 175 A <sup>1)</sup> (in steps of 0.05 A)
Tolerances	
For sensitive 5-A-transformer	3 % of setting value or 5 mA <sup>1)</sup>
For normal 5-A-transformer	Approx. 20 % for setting values $< 10$ mA
Angle tolerance	3 % of setting value or 75 mA <sup>1)</sup>
	3°

Note: Due to the high sensitivity, the linear range of the measuring input  $I_{nom}$  with integrated sensitive input transformer is from  $0.001 \cdot I_{nom}$  to  $1.6 \cdot I_{nom}$ . For currents greater than  $1.6 \cdot I_{nom}$  correct direction determination can no longer be guaranteed.

**Auto-reclosure (ANSI 79)**

Number of reclosures	0 to 9
	Shot 1 to 4 individually adjustable
Program for phase fault Start-up by	Time-overcurrent elements (directional/non-directional), negative sequence, binary input
Program for ground fault Start-up by	Time-overcurrent elements (directional/non-directional), sensitive ground-fault protection, binary input
Blocking of ARC	Pickup of protection functions, three-phase fault detected by a protective element (optional), binary input, last TRIP command after the reclosing cycle is completed (unsuccessful reclosing), TRIP command by the breaker failure protection (50BF), opening the CB without ARC initiation, external CLOSE command, circuit-breaker monitoring
Setting ranges	
Dead time $T_{Dead}$ (separate for phase and ground and individual for shots 1 to 4)	0.01 to 320 s (in steps of 0.01 s)
Blocking duration for manual-CLOSE detection	0.5 s to 320 s or 0 (in steps of 0.01 s)
Blocking duration after reclosure	0.5 s to 320 s (in steps of 0.01 s)
Blocking duration after dynamic blocking	0.01 to 320 s (in steps of 0.01 s)
Start-signal monitoring time	0.01 to 320 s or $\infty$ (in steps of 0.01 s)
Circuit-breaker monitoring time	0.1 to 320 s (in steps of 0.01 s)
Max. delay of dead-time start	0 to 1800 s or $\infty$ (in steps of 0.1 s)
Start delay of dead time	Using binary input with time monitoring
Maximum dead time extension	0.5 to 320 s or $\infty$ (in steps of 0.01 s)
Action time (operation time)	0.01 to 320 s or $\infty$ (in steps of 0.01 s)

1) At  $I_{nom} = 1$  A, all limits divided by 5.

## Technical data

**Auto-reclosure (ANSI 79) (con'd)**

The delay times of the following protection function can be altered individually by the ARC for shots 1 to 4  
(setting value:  $T = T$ ; non-delayed:  $T = 0$ ; blocking:  $T = \infty$ ):  
50-1, 50-2, 50-3, 51, 67-1, 67-2, 67-TOC, 50N-1, 50N-2, 50N-3, 51N, 67N-1, 67N-2, 67N-TOC

Additional functions                      Lockout (final trip), circuit-breaker monitoring, evaluation of the CB contacts, synchronous closing (optionally with integrated or external synch-check)

**Fault locator (ANSI 21FL)**

Output of the fault distance              in  $\Omega$  primary and secondary, in km or miles line length, in % of line length

Starting signal, trigger                      Trip command, dropout of a protection element, or external command via binary input

Setting ranges  
Reactance (secondary)                      0.001 to 1.9  $\Omega/\text{km}^2$  (in steps of 0.0001)  
0.001 to 3  $\Omega/\text{mile}^2$  (in steps of 0.0001)

Tolerances  
Measurement tolerance acc. to VDE 0435, Part 303 for sinusoidal measurement quantities                      2.5 % fault location (without intermediate infeed) for  $30^\circ \leq \varphi_K \leq 90^\circ$  and  $V_K/V_{\text{nom}} \geq 0.1$  and  $I_K/I_{\text{nom}} \geq 1$

**Breaker failure protection (ANSI 50BF)**

Setting ranges  
Pickup thresholds                              0.25 to 100  $\text{A}^{1)}$  (in steps of 0.01 A)  
Delay time    0.06 to 60 s or  $\infty$  (in steps of 0.01 s)

Times  
Pickup times  
with internal start                              is included in the delay time  
with external start                              is included in the delay time  
Dropout times                                      Approx. 25 ms

Tolerances  
Pickup thresholds                              3 % of setting value or 75  $\text{mA}^{1)}$   
Delay time    1 % or 20 ms

**Flexible protection functions (e.g. ANSI 27, 32, 37, 47, 50, 55, 59, 81R)**

Operating modes/measuring quantities  
3-phase     $I, I_1, I_2, I_2/I_1, 3I_0, V, V_1, V_2, 3V_0, P_{\text{forward}}, P_{\text{reverse}}, Q_{\text{forward}}, Q_{\text{reverse}}, \cos \varphi$

1-phase     $I, I_N, I_{NS}, I_{N2}, V, V_N, V_x, P_{\text{forward}}, P_{\text{reverse}}, Q_{\text{forward}}, Q_{\text{reverse}}, \cos \varphi$

Without fixed phase relation  
Pickup when                                       $f, df/dt$ , binary input  
Exceeding or falling below threshold value

Setting ranges  
Pickup thresholds  
Current  $I, I_1, I_2, 3I_0, I_N$                       0.25 to 200  $\text{A}^{1)}$  (in steps of 0.01 A)  
Current ratio  $I_2/I_1$                               15 to 100 % (in steps of 1 %)  
Sensitive ground current  $I_{NS}$               0.001 to 1.5 A (in steps of 0.001 A)  
Voltages  $V, V_1, V_2, 3V_0$                       2 to 260 V (in steps of 0.1 V)  
Displacement voltage  $V_N$                       2 to 200 V (in steps of 0.1 V)

## Setting ranges, continued

Power  $P, Q$     10 to 50000  $\text{W}^{1)}$  (in steps of 0.1 W)  
Power factor ( $\cos \varphi$ )                              -0.99 to +0.99 (in steps of 0.01)

Frequency  $f_N = 50$  Hz                              40 to 60 Hz (in steps of 0.01 Hz)  
 $f_N = 60$  Hz    50 to 70 Hz (in steps of 0.01 Hz)

Rate-of-frequency change  $df/dt$               0.1 to 20 Hz/s (in steps of 0.01 Hz/s)

Dropout ratio >- element                      1.01 to 3 (in steps of 0.01)  
Dropout ratio <- element                      0.7 to 0.99 (in steps of 0.01)  
Dropout difference  $f$                               0.02 to 1 Hz (in steps of 0.01 Hz)  
Pickup delay time (standard)                  0 to 60 s (in steps of 0.01 s)  
Pickup delay for  $I_2/I_1$                               0 to 28800 s (in steps of 0.01 s)  
Trip delay time                                      0 to 3600 s (in steps of 0.01 s)  
Dropout delay time                                  0 to 60 s (in steps of 0.01 s)

Times  
Pickup times  
Current, voltage (phase quantities)  
With 2 times the setting value              Approx. 30 ms  
With 10 times the setting value              Approx. 20 ms

Current, voltages (symmetrical components)  
With 2 times the setting value              Approx. 40 ms  
With 10 times the setting value              Approx. 30 ms

Power  
Typical    Approx. 120 ms  
Maximum (low signals and thresholds)      Approx. 350 ms

Power factor    300 to 600 ms  
Frequency    Approx. 100 ms

Rate-of-frequency change  
With 1.25 times the setting value              Approx. 220 ms  
Binary input    Approx. 20 ms

Dropout times  
Current, voltage (phase quantities)              < 20 ms  
Current, voltages (symmetrical components)      < 30 ms

Power  
Typical    < 50 ms  
Maximum    < 350 ms

Power factor    < 300 ms  
Frequency    < 100 ms  
Rate-of-frequency change                      < 200 ms  
Binary input    < 10 ms

Tolerances  
Pickup thresholds  
Current    3 % of setting value or 75  $\text{mA}^{1)}$   
Current (symmetrical components)              4 % of setting value or 100  $\text{mA}^{1)}$   
Voltage    3 % of setting value or 0.2 V  
Voltage (symmetrical components)              4 % of setting value or 0.2 V

Power    3 % of setting value or 2.5  $\text{W}^{1)}$   
(for rated values)  
Power factor    3 degrees  
Frequency    15 mHz

Rate-of-frequency change                      5 % of setting value or 0.05 Hz/s  
Times    1 % of setting value or 10 ms

1) At  $I_{\text{nom}} = 1$  A, all limits divided by 5.2) At  $I_{\text{nom}} = 1$  A, setting range to be multiplied by 5.

## Technical data

## Synch-check (ANSI 25)

Operating mode	• Synch-check
Additional release conditions	• Live-bus / dead line • Dead-bus / live-line • Dead-bus and dead-line • Bypassing
<b>Voltages</b>	
Max. operating voltage $V_{max}$	20 to 140 V (phase-to-phase) (in steps of 1 V)
Min. operating voltage $V_{min}$	20 to 125 V (phase-to-phase) (in steps of 1 V)
$V <$ for dead-line	1 to 60 V (phase-to-phase) (in steps of 1 V)
$V >$ for live-line	20 to 140 V (phase-to-phase) (in steps of 1 V)
Primary rated voltage of transformer $V_{2nom}$	0.1 to 800 kV (in steps of 0.01 kV)
Tolerances	2 % of pickup value or 2 V
Dropout ratios	Approx. 0.9 ( $V >$ ) or 1.1 ( $V <$ )
<b>Permissible differences</b>	
Voltage difference $V_2 > V_1$ ; $V_2 < V_1$	0.5 to 50 V (phase-to-phase) (in steps of 1 V)
Tolerance	1 V
<b>Frequency differences</b>	
$f_2 > f_1$ ; $f_2 < f_1$	0.01 to 2 Hz (in steps of 0.01 Hz)
Tolerance	30 mHz
<b>Angle differences</b>	
$\alpha_2 > \alpha_1$ ; $\alpha_2 < \alpha_1$	2 ° to 80 ° (in steps of 1 °)
Tolerance	2 °
Max. phase displacement	5 ° for $\Delta f \leq 1$ Hz 10 ° for $\Delta f \leq 1$ Hz
<b>Vector group matching by angle</b>	
Different voltage transformers $V_1/V_2$	0 ° to 360 ° (in steps of 1 °) 0.5 to 2 (in steps of 0.01)
<b>Times</b>	
Minimum measuring time	Approx. 80 ms
Max. duration $T_{SYN DURATION}$	0.01 to 1200 s; $\infty$ (in steps of 0.01 s)
Supervision time $T_{SUP VOLTAGE}$	0 to 60 s (in steps of 0.01 s)
Tolerance of all times	1 % of setting value or 10 ms
<b>Measuring values of synch-check function</b>	
Reference voltage $V_1$ and voltage to be synchronized $V_2$	In kV primary, in V secondary or in % $V_{nom}$
Range	10 to 120 % of $V_{nom}$
Tolerance*)	$\leq 1$ % of measured value or 0.5 % of $V_{nom}$
Frequency of voltage $V_1$ and $V_2$	$f_1, f_2$ in Hz
Range	25 Hz $\leq f \leq 70$ Hz
Tolerance*)	20 mHz
Voltage difference ( $V_2 - V_1$ )	In kV primary, in V secondary or in % $V_{nom}$
Range	10 to 120 % $V_{nom}$
Tolerance*)	$\leq 1$ % of measured value or 0.5 % of $V_{nom}$
Frequency difference ( $f_2 - f_1$ )	In mHz
Range	$f_{nom} \pm 3$ Hz
Tolerance*)	30 mHz
Angle difference ( $\alpha_2 - \alpha_1$ )	In °
Range	0 to 180 °
Tolerance*)	1 °

## Additional functions

## Operational measured values

Currents $I_{A(L1)}, I_{B(L2)}, I_{C(L3)}$ Positive-sequence component $I_1$ Negative-sequence component $I_2$ $I_E$ or $3I_0$	In A (kA) primary, in A secondary or in % $I_{nom}$
Range	10 to 150 % $I_{nom}$
Tolerance*)	1.5 % of measured value or 1 % $I_{nom}$ and from 151 to 200 % $I_{nom}$ 3 % of measured value
<b>Voltages</b>	
Phase-to-ground voltages $V_{A-N}, V_{B-N}, V_{C-N}$	In kV primary, in V secondary or in % $V_{nom}$
Phase-to-phase voltages $V_{A-B}, V_{B-C}, V_{C-A}, V_{SYN}$ $V_N, V_{Ph-N}, V_x$ or $V_0$	
Positive-sequence component $V_1$	
Negative-sequence component $V_2$	
Range	10 to 120 % of $V_{nom}$
Tolerance*)	1.5 % of measured value or 0.5 % of $V_{nom}$
S, apparent power	In kVAr (MVar or GVar) primary and in % of $S_{nom}$
Range	0 to 120 % of $S_{nom}$
Tolerance*)	1.5 % of $S_{nom}$ for $V/V_{nom}$ and $I/I_{nom} = 50$ to 120 %
P, active power	With sign, total and phase-segregated in kW (MW or GW) primary and in % $S_{nom}$
Range	0 to 120 % of $S_{nom}$
Tolerance*)	2 % of $S_{nom}$ for $V/V_{nom}$ and $I/I_{nom} = 50$ to 120 % and $ \cos \varphi  = 0.707$ to 1 with $S_{nom} = \sqrt{3} \cdot V_{nom} \cdot I_{nom}$
Q, reactive power	With sign, total and phase-segregated in kVAr (MVar or GVar) primary and in % of $S_{nom}$
Range	0 to 120 % of $S_{nom}$
Tolerance*)	2 % of $S_{nom}$ for $V/V_{nom}$ and $I/I_{nom} = 50$ to 120 % and $ \sin \varphi  = 0.707$ to 1 with $S_{nom} = \sqrt{3} \cdot V_{nom} \cdot I_{nom}$
$\cos \varphi$ , power factor (p.f.)	Total and phase-segregated
Range	-1 to +1
Tolerance*)	2 % for $ \cos \varphi  \geq 0.707$
Frequency $f$	In Hz
Range	$f_{nom} \pm 5$ Hz
Tolerance*)	20 mHz
Temperature overload protection $\Theta/\Theta_{Trip}$	In %
Range	0 to 400 %
Tolerance*)	5 % class accuracy per IEC 60255-8
Currents of sensitive ground-fault detection (total, active, and reactive current) $I_{Ns}, I_{Ns active}, I_{Ns reactive}$ ; ( $I_{EE}, I_{EE active}, I_{EE reactive}$ )	In A (kA) primary and in mA secondary
Range	0 mA to 8000 mA for $I_{nom} = 5$ A <sup>1)</sup>
Tolerance*)	3 % of measured value or 1 mA

\*) With rated frequency.

1) At  $I_{nom} = 1$  A, all limits divided by 5.

## Technical data

Long-term averages	
Time window	5, 15, 30 or 60 minutes
Frequency of updates	Adjustable
Long-term averages of currents	$I_{Admd}, I_{Bdmd}, I_{Cdmd}$ ( $I_{L1dmd}, I_{L2dmd}, I_{L3dmd}$ ) $I_{1dmd}$ in A (kA)
of active power	$P_{dmd}$ in W (kW, MW)
of reactive power	$Q_{dmd}$ in VAR (kVAR, MVAR)
of apparent power	$S_{dmd}$ in VAR (kVAR, MVAR)
Max. / Min. report	
Report of measured values	With date and time
Reset, automatic	Time of day adjustable (in minutes, 0 to 1439 min) Time frame and starting time adjustable (in days, 1 to 365 days, and $\infty$ )
Reset, manual	Using binary input, using keypad, via communication
Min./Max. values for current	$I_{A(L1)}, I_{B(L2)}, I_{C(L3)}$ $I_1$ (positive-sequence component)
Min./Max. values for voltages	$V_{A-N}, V_{B-N}, V_{C-N}$ ( $V_{L1-E}, V_{L2-E}, V_{L3-E}$ ) $V_1$ (positive-sequence component) $V_{A-B}, V_{B-C}, V_{C-A}$ ( $V_{L1-L2}, V_{L2-L3}, V_{L3-L1}$ )
Min./Max. values for power	$S, P, Q, \cos \varphi$ , frequency
Min./Max. values for overload protection	$\Theta/\Theta_{Trip}$
Min./Max. values for mean values	$I_{Admd}, I_{Bdmd}, I_{Cdmd}$ ( $I_{L1dmd}, I_{L2dmd}, I_{L3dmd}$ ) $I_1$ (positive-sequence component); $S_{dmd}, P_{dmd}, Q_{dmd}$
Local measured values monitoring	
Current asymmetry	$I_{max}/I_{min} >$ balance factor, for $I > I_{balance\ limit}$
Voltage asymmetry	$V_{max}/V_{min} >$ balance factor, for $V > V_{lim}$
Current sum	$ i_A + i_B + i_C + k_j \cdot i_N  >$ limit value
Current phase sequence	Clockwise (ABC) / counter-clockwise (ACB)
Voltage phase sequence	Clockwise (ABC) / counter-clockwise (ACB)
Fault event recording	
Recording of indications of the last 8 power system faults	
Recording of indications of the last 3 power system ground faults	
Time stamping	
Resolution for event log (operational annunciations)	1 ms
Resolution for trip log (fault annunciations)	1 ms
Maximum time deviation (internal clock)	0.01 %
Battery	Lithium battery 3 V/1 Ah, type CR 1/2 AA, message "Battery Fault" for insufficient battery charge
Oscillographic fault recording	
Maximum 8 fault records saved, memory maintained by buffer battery in case of loss of power supply	
Recording time	5 s per fault record, in total up to 18 s
Sampling rate for 50 Hz	1 sample/1.00 ms
Sampling rate for 60 Hz	1 sample/0.83 ms
Energy/power	
Meter values for power ( $W_p, W_q$ (active and reactive power demand))	in kWh (MWh or GWh) and kVARh (MVARh or GVARh)
Tolerance*)	$\leq 2\%$ for $I > 0.1 I_{nom}, V > 0.1 V_{nom}$ and $ \cos \varphi $ (p.f.) $\geq 0.707$
Statistics	
Saved number of trips	Up to 9 digits
Number of automatic reclosing commands (segregated according to 1 <sup>st</sup> and $\geq 2^{nd}$ cycle)	Up to 9 digits
Accumulated interrupted current (segregated acc. to pole)	Up to 4 digits
Operating hours counter	
Display range	Up to 7 digits
Criterion	Overshoot of an adjustable current threshold (element 50-1, BkrClosed $I_{MIN}$ )
Circuit-breaker monitoring	
Calculation methods	On r.m.s.-value basis: $\Sigma I, \Sigma I^x, 2 P$ On instantaneous value basis: $\Sigma i^2 t$
Measured-value acquisition/processing	Phase-selective
Evaluation	One limit value each per subfunction
Saved number of statistical values	Up to 13 digits
Trip circuit monitoring	
With one or two binary inputs	
Commissioning aids	
Phase rotation test, operational measured values, circuit-breaker test by means of control function, creation of a test fault report, creation of messages	
Clock	
Time synchronization	Binary input, communication
Setting group switchover of the function parameters	
Number of available setting groups	4 (parameter group A, B, C and D)
Switchover performed	Via keypad, DIGSI using the operator interface, protocol using port B or binary input

\*) With rated frequency.



**Technical data****Breaker control**

Number of switching units	Depends on the binary inputs and outputs available
Interlocking	Freely programmable
Messages	Feedback messages, closed, open, intermediate position
Control commands	Single command / double command
Switching command to circuit-breaker	1-, 1½- and 2-pole
Programmable logic controller	PLC logic, graphic input tool
Local control	Control via menu, assignment of function keys
Remote control	Via communication interfaces, using a substation automation and control system (e.g. SICAM), using DIGSI 4 (e.g. via modem)

**CE conformity**

This product is in conformity with the Directives of the European Communities on the harmonization of the laws of the Member States relating to electromagnetic compatibility (EMC Council Directive 89/336/EEC) and electrical equipment designed for use within certain voltage limits (Council Directive 73/23/EEC).

This unit conforms to the international standard IEC 60255, and the German standard DIN 57435/Part 303 (corresponding to VDE 0435/Part 303).

Further applicable standards: ANSI/IEEE C37.90.0 and C37.90.1.

The unit conforms to the international standard IEC 60255, and the German standard DIN 57435/Part 303 (corresponding to VDE 0435/Part 303).

This conformity is the result of a test that was performed by Siemens AG in accordance with Article 10 of the Council Directive complying with the generic standards EN 50081-2 and EN 50082-2 for the EMC Directive and standard EN 60255-6 for the "low-voltage Directive".

**Notes**

Subject to change without prior notice.

We reserve the right to include modifications.

Drawings are not binding.

If not stated otherwise, all dimensions in this catalog are given in mm/inch.

The information in this document contains general descriptions of the technical options available, which do not always have to be present in individual cases. The required features should therefore be specified in each individual case at the time of closing the contract.

Selection and ordering data

Description	Order No.
<i>7SJ80 overcurrent protection device</i>	7SJ80□□ - □□□□□ - □□□□
<i>Housing, binary inputs and outputs</i>	
Housing 1/6 19", 4 x I, 3 BI, 5 BO (2 changeover/Form C), 1 live status contact	1
Housing 1/6 19", 4 x I, 7 BI, 8 BO (2 changeover/Form C), 1 live status contact	2
Housing 1/6 19", 4 x I, 3 x V, 3 BI, 5 BO (2 changeover/Form C), 1 live status contact	3
Housing 1/6 19", 4 x I, 3 x V, 7 BI, 8 BO (2 changeover/Form C), 1 live status contact	4
<i>Measuring inputs, default settings</i>	
$I_{ph} = 1\text{ A} / 5\text{ A}, I_e = 1\text{ A} / 5\text{ A}$	1
$I_{ph} = 1\text{ A} / 5\text{ A}, I_{ee} (\text{sensitive}) = 0.001\text{ to }1.6\text{ A} / 0.005\text{ to }8\text{ A}$	2
<i>Rated auxiliary voltage</i>	
24 V / 48 V DC	1
60 V / 110 V / 125 V / 220 V DC, 115 V, 230 V AC	5
<i>Unit version</i>	
Surface-mounting housing, screw-type terminal	B
Flush-mounting housing, screw-type terminal	E
<i>Region-specific default and language settings</i>	
Region DE, IEC, language German (language selectable), standard front	A
Region World, IEC/ANSI, language English (language selectable), standard front	B
Region US, ANSI, language US-English (language selectable), US front	C
Region FR, IEC/ANSI, language French (language selectable), standard front	D
Region World, IEC/ANSI, language Spanish (language selectable), standard front	E
Region World, IEC/ANSI, language Italian (language selectable), standard front	F
Region RUS, IEC/ANSI, language Russian (language selectable), standard front	G
Region CHN, IEC/ANSI, language Chinese (language not changeable), Chinese front	K

see next page


## Selection and ordering data

Description	Order No.	Order code
<i>7SJ80 overcurrent protection device</i>	<i>7SJ80□□ - □□□□□ - □□□□</i>	<i>L 0 □</i>
<i>Port B (at bottom of device, rear)</i>		
No port	0	
IEC 60870-5-103 or DIGSI 4/modem, electrical RS232	1	
IEC 60870-5-103 or DIGSI 4/modem, electrical RS485	2	
IEC 60870-5-103 or DIGSI 4/modem, optical 820 nm, ST connector	3	
PROFIBUS-DP Slave, electrical RS485	9	L 0 A
PROFIBUS-DP Slave, optical, double ring, ST connector	9	L 0 B
MODBUS, electrical RS485	9	L 0 D
MODBUS, optical 820 nm, ST connector	9	L 0 E
DNP 3.0, electrical RS485	9	L 0 G
DNP 3.0, optical 820 nm, ST connector	9	L 0 H
IEC 60870-5-103, redundant, electrical RS485, RJ45 connector	9	L 0 P
IEC 61850, 100 Mbit Ethernet, electrical, double, RJ45 connector	9	L 0 R
IEC 61850, 100 Mbit Ethernet, optical, double, LC connector	9	L 0 S
<i>Port A (at bottom of device, in front)</i>		
No port	0	
With Ethernet interface (DIGSI, not IEC 61850), RJ45 connector	6	
<i>Measuring/fault recording</i>		
With fault recording	1	
With fault recording, average values, min/max values	3	

↑ ↑ ↑ ↑ ↑ ↑ ↑ ↑  
see following page

Selection and ordering data

Description		Order No.
7SJ80 overcurrent protection device		7SJ80□□ - □□□□□ - □□□□□
Designation	ANSI No.	Description
<b>Basic version</b>		
	50/51	Time-overcurrent protection phase $I>$ , $I>>$ , $I>>>$ , $I_p$
	50N/51N	Time-overcurrent protection ground $I_{E>}$ , $I_{E>>}$ , $I_{E>>>}$ , $I_{Ep}$
	50N(s)/51N(s) <sup>1)</sup>	Sensitive ground fault protection $I_{EE>}$ , $I_{EE>>}$ , $I_{EEp}$
	87N <sup>2)</sup>	High impedance REF
	49	Overload protection
	74TC	Trip circuit supervision
	50BF	Circuit-breaker failure protection
	46	Negative-sequence protection
	37	Undercurrent monitoring
	86	Lockout
		Parameter changeover
		Monitoring functions
		Control of circuit-breaker
		Flexible protection functions (current parameters)
		Inrush restraint
<b>Basic version + directional sensitive ground fault, voltage and frequency protection</b>		
■	67N	Directional overcurrent protection ground $I_{E>}$ , $I_{E>>}$ , $I_{Ep}$
	67N(s) <sup>1)</sup>	Directional sensitive ground fault protection $I_{EE>}$ , $I_{EE>>}$ , $I_{EEp}$
	64/59N	Displacement voltage
	27/59	Under-/overvoltage
	81U/O	Under-/overfrequency, $f<$ , $f>$
	47	Phase rotation
	32/55/81R	Flexible protection functions (current and voltage parameters): Protective function for voltage, power, power factor, frequency change
<b>Basic version + directional phase &amp; ground overcurrent, directional sensitive ground fault, voltage and frequency protection</b>		
■	67	Directional overcurrent protection phase $I>$ , $I>>$ , $I_p$
	67N	Directional overcurrent protection ground $I_{E>}$ , $I_{E>>}$ , $I_{Ep}$
	67N(s) <sup>1)</sup>	Directional sensitive ground fault protection $I_{EE>}$ , $I_{EE>>}$ , $I_{EEp}$
	64/59N	Displacement voltage
	27/59	Under-/overvoltage
	81U/O	Under-/overfrequency, $f<$ , $f>$
	47	Phase rotation
	32/55/81R	Flexible protection functions (current and voltage parameters): Protective function for voltage, power, power factor, frequency change
<b>Basic version + directional phase overcurrent, voltage and frequency protection + synch-check</b>		
■	67	Directional overcurrent protection phase $I>$ , $I>>$ , $I_p$
	27/59	Under-/overvoltage
	81U/O	Under-/overfrequency, $f<$ , $f>$
	47	Phase rotation
	25	Synch-check
	81R	Flexible protection functions (current and voltage parameters): Protective function for voltage, frequency change
<b>Auto-reclosure, fault locator</b>		
		Without
	79	With auto-reclosure
	21FL	With fault locator
	79/21FL	With auto-reclosure, with fault locator



- Basic version included
- 1) Depending on the ground current input the function will be either sensitive ( $I_{sc}$ ) or non-sensitive ( $I_c$ ).
- 2) 87N (REF) only with sensitive ground current input (position 7 = 2).
- 3) Only if position 6 = 1 or 2.
- 4) Only if position 6 = 3 or 4.
- 5) Only if position 6 = 3 or 4 and position 16 = 0 or 1.

## Sample order

Position	Order No. + Order code
	<b>7SJ8041-5EC96-3FC1+LOG</b>
6 I/O's: 7 BI/8 BO, 1 live status contact	4
7 Current transformer: $I_{ph} = 1 A / 5 A$ , $I_e = 1 A / 5 A$	1
8 Power supply: 60 to 250 V DC, 115 V AC to 230 V AC	5
9 Unit version: Flush-mounting housing, screw-type terminals	E
10 Region: US, English language (US); 60 Hz, ANSI	C
11 Communication: System interface: DNP 3.0, RS485	9
12 Communication: Ethernet interface (DIGSI, not IEC 61850)	6
13 Measuring/fault recording: Extended measuring and fault records	3
14/15 Protection function package: Basic version plus directional TOC	FC
16 With auto-reclosure	1

## Accessories

Description	Order No.
<b>DIGSI 4</b>	
Software for configuration and operation of Siemens protection units running under MS Windows 2000/XP Professional Edition/Vista.	
Basis Full version with license for 10 computers, on CD-ROM (authorization by serial number)	7XS5400-0AA00
Professional DIGSI 4 Basis and additionally SIGRA (fault record analysis), CFC Editor (logic editor), Display Editor (editor for default and control displays) and DIGSI 4 Remote (remote operation)	7XS5402-0AA00
Professional + IEC 61850 Complete version: DIGSI 4 Basis and additionally SIGRA (fault record analysis), CFC Editor (logic editor), Display Editor (editor for default and control displays) and DIGSI 4 Remote (remote operation) + IEC 61850 system configurator	7XS5403-0AA00
<b>Terminals</b>	
Voltage terminal block C or block E	C53207-A406-D181-1
Voltage terminal block D (inverse print)	C53207-A406-D182-1
Current terminal block 4 x I	C53207-A406-D185-1
Current terminal block 3 x I, 1 x $I_{Ns}$ (sensitive)	C53207-A406-D186-1
Current terminal short-circuit links (3 pieces)	C53207-A406-D193-1
Voltage terminal short-circuit links (6 pieces)	C53207-A406-D194-1
<b>Varistor/Voltage arrester</b>	
Voltage arrester for high-impedance REF protection 125 Vrms; 600 A; 1S/S 256	C53207-A401-D76-1
240 Vrms; 600 A; 1S/S 1088	C53207-A401-D77-1
<b>Manual for 7SJ80</b>	
English	E50417-G1140-C343-A4
German	E50417-G1100-C343-A4
<b>Mounting rail set for 19" rack</b>	C73165-A63-D200-1

Connection diagram

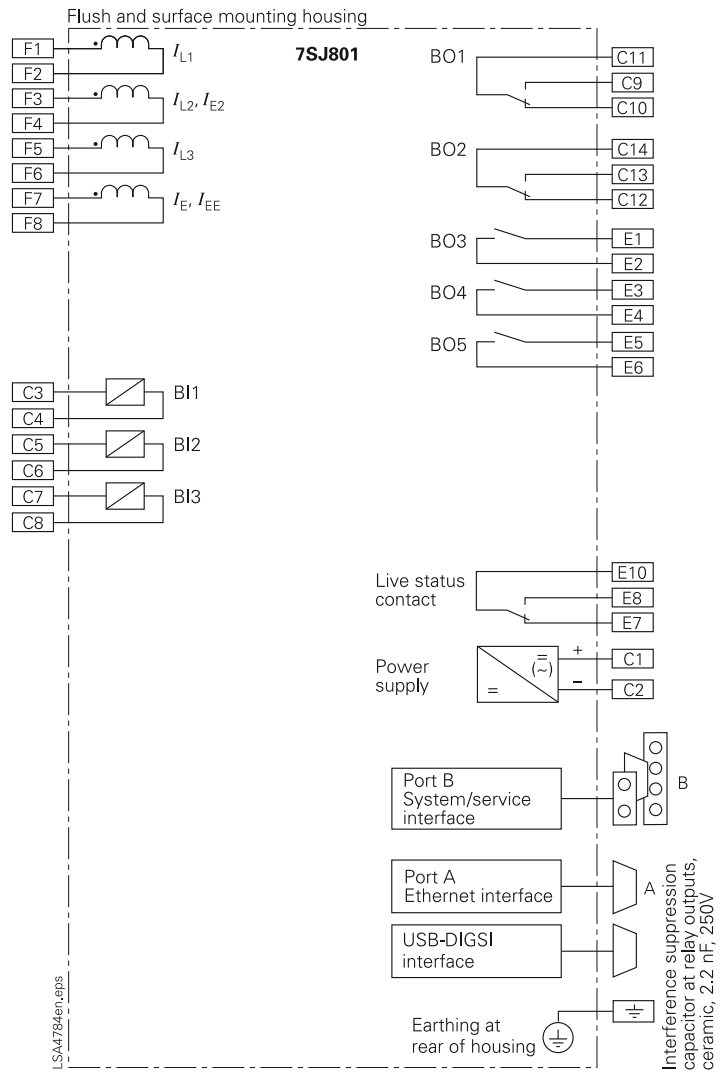


Fig. 5/74 7SJ801 connection diagram

Connection diagram

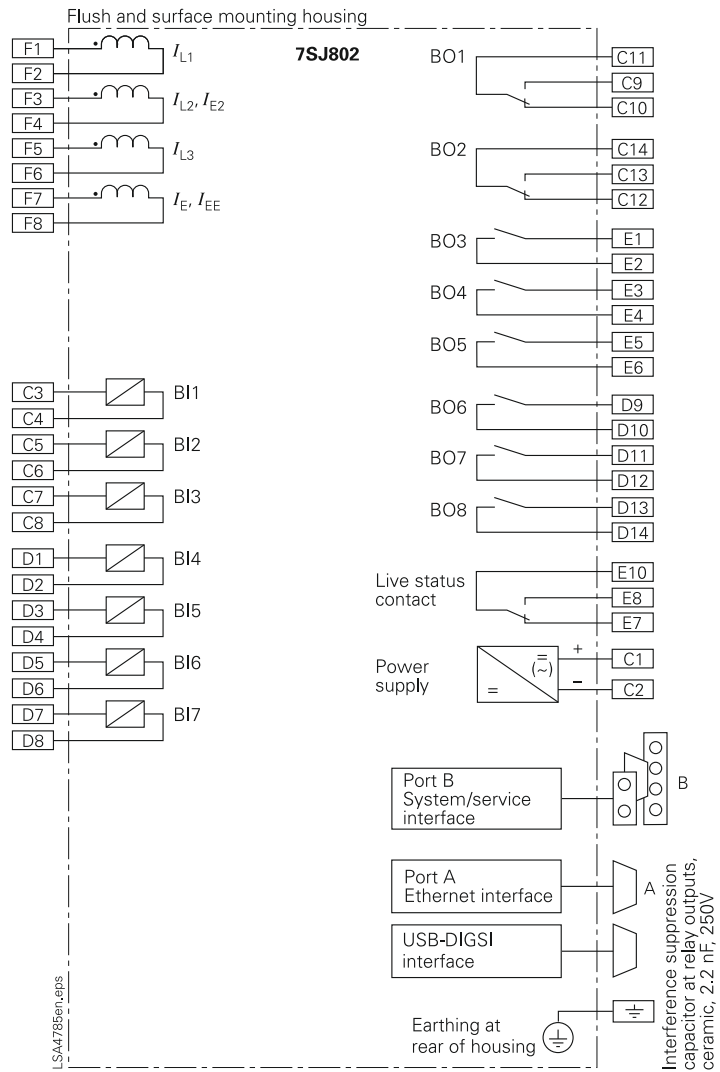


Fig. 5/75 7SJ802 connection diagram

Connection diagram

5

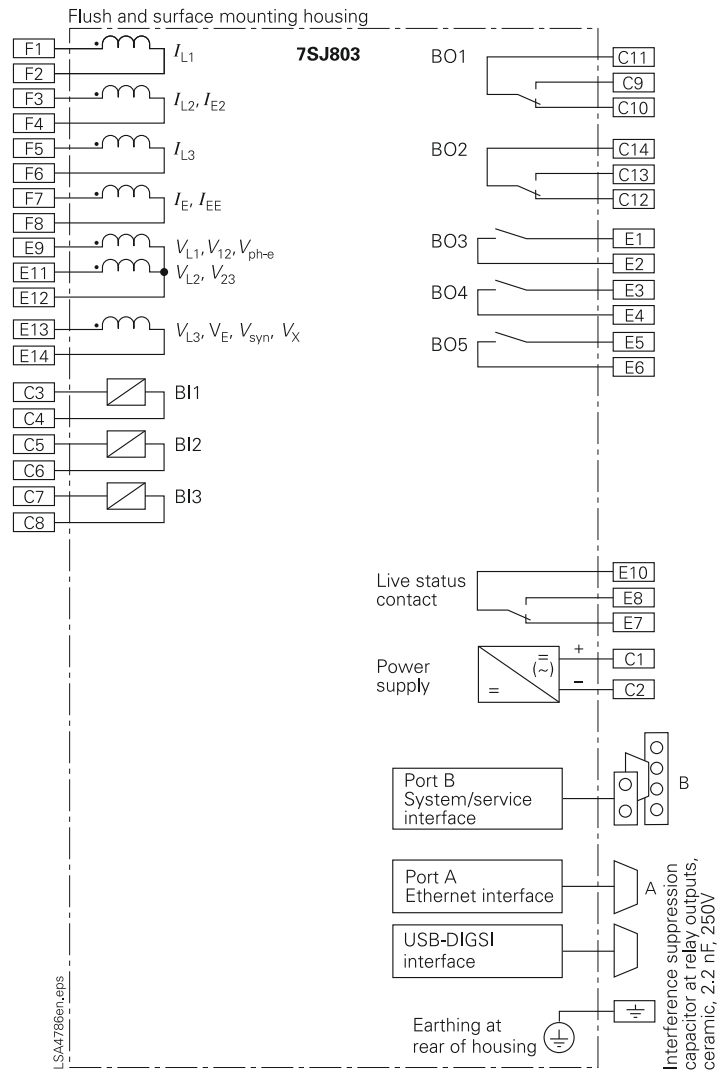


Fig. 5/76 7SJ803 connection diagram



Connection diagram


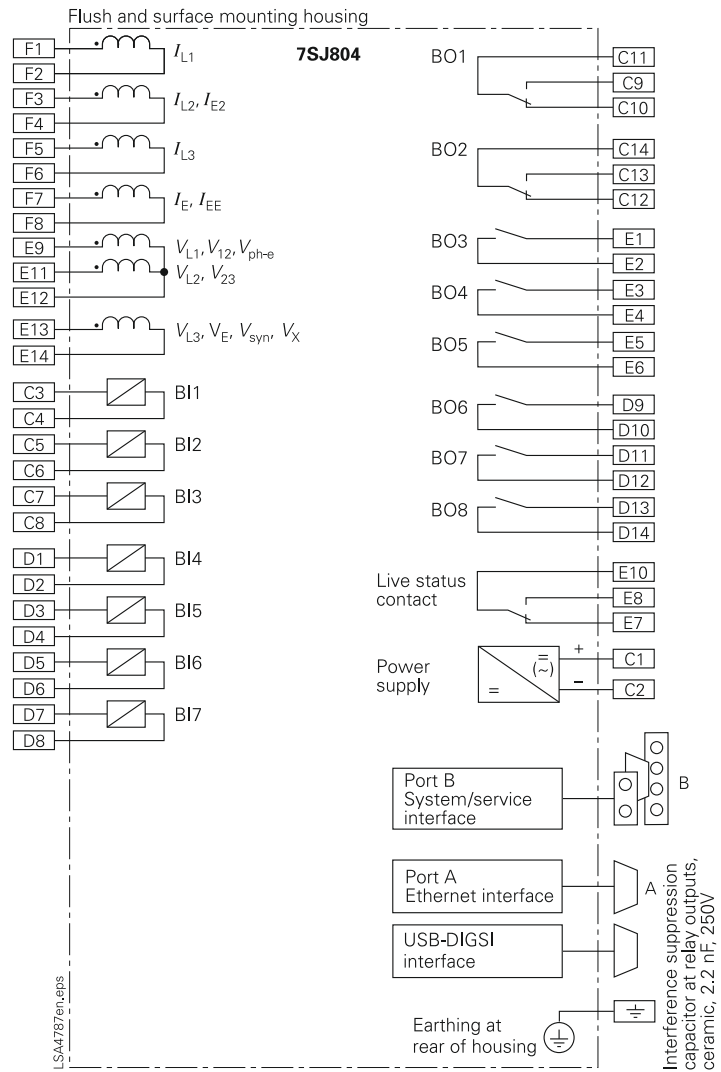



Fig. 5/77 7SJ804 connection diagram

Dimension drawings in mm / inch

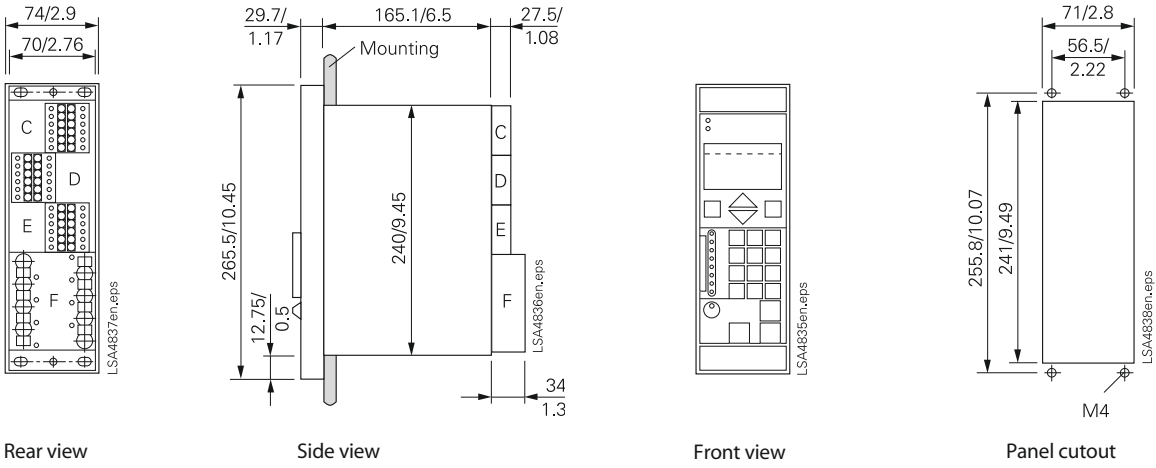

5

**Fig. 17/22**  
7SJ80/7SK80 protection relays  
for panel flush mounting/cubicle mounting

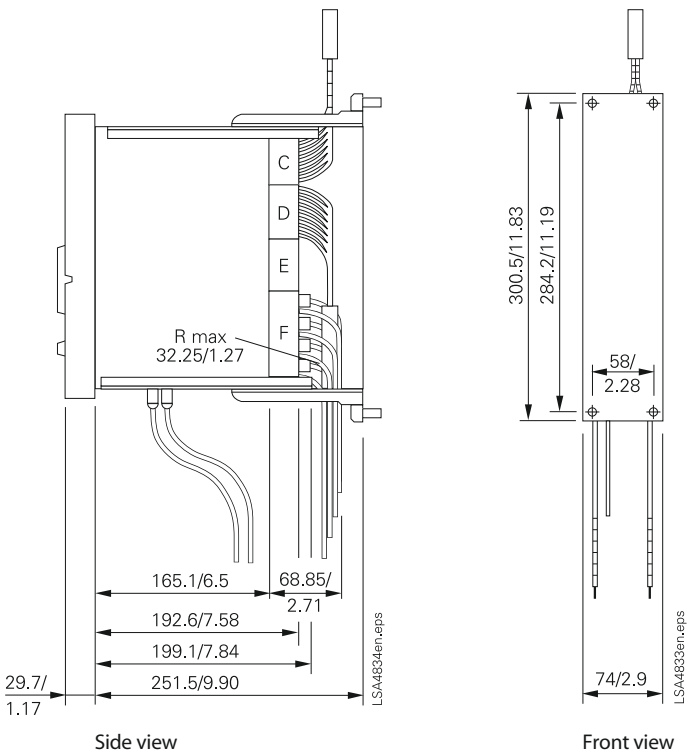

**Fig. 17/23**  
7SJ80/7SK80 protection relays  
for panel surface mounting